

Zancanella & Associates, Inc.
Memorandum

To: Kjell Mitchell, Brian Ammerman – Hot Springs Pool
From: Tom Zancanella and Tony Zancanella
Date: October 29, 2014
Subject: Bacteria Testing

The Hot Springs Pool has historically tested on a weekly basis for fecal, e-coli, and total coliform bacteria in the swimming pools. According to the Department of Public Health and Environment Water Quality Control Division 5 CCR 1003-5 the State Board of Health Regulations Pertaining to Swimming Pools and Mineral Baths has determined that the bacterial quality of the water in pools shall not have a fecal coliform density in excess of one per 100 ml at any time. In addition the WQCD has set a limit for water samples to not contain more than 200 bacteria per milliliter or 20,000 colonies per 100 ml sample.

There is currently no limit for E-coli or *Pseudomonas* Dermatitis / Folliculitis. We test weekly for E-coli coliform as an indicator for Fecal coliform due to the complexity of testing for Fecal coliform. According to Standard Methods for the Examination of Water and Wastewater SM 9060B the “Preservation and Storage” requirement requires a sample to be analyzed within 6 hours of collection. In order to conduct a *Pseudomonas* test the sample has to be sent to either Grand Junction or Denver for analysis and therefore results in an exceedance of the hold time for the sample.

In August of 2014 the West Glenwood lab was closed for a 2 week period. During this time the samples were sent to Mesa County Labs to be analyzed. Mesa County Lab no longer accepts samples for Fecal analysis, therefore as an alternative we sampled for *Pseudomonas* and sent to Mesa County to test for the interim. The results for the Main pool were <1.0 MPN on both sampling occasions shown in the monthly summary of coliform analysis. The Therapy pool results were 3.0 MPN and 1.0 MPN over the two testing occasions. The only other time *Pseudomonas* was sampled was in 2011 and all of the results were determined to be <1.0 MPN, there were approximately four set of samples taken.

It is our understanding that no determination by the Center For Disease Control (CDC) has been set for a limit of *pseudomonas* in swimming pools, we also checked with Mesa County Labs and they did not believe a limit has been determined at this time.

Zancanella & Associates, Inc.

Hot Springs Pool August 2014 Coliform Summary

Permit Number: COG600308
Prepared By: MVW

Location: Main Pool

Date	Parameter Measurement		
	Fecal / Pseudomonas	E Coli	Total Coliform
	Colonies/100ml	Colonies/100ml	Colonies/100ml
8/6/2014**	0	0	4
8/13/2014**	0	0	0
8/20/2014	1	0	1
8/27/2014	1	0	1
Average	0.316	0.000	0.795

Location: Therapy Pool

Date	Parameter Measurement		
	Fecal / Pseudomonas	E Coli	Total Coliform
	Colonies/100ml	Colonies/100ml	Colonies/100ml
8/6/2014**	3	0	0
8/13/2014**	1	0	0
8/20/2014	1	1	1
8/27/2014	1	0	0
Average	1.316	0.178	0.178

Limits		
Fecal	E Coli	Total Coliform
>1 per 100ml	235 per 100ml	20,000 per 100ml

** No Fecal was completed samples analyzed at Mesa County due to W-Glenwood lab was closed, alternative analysis was performed as MPN of Pseudomonas. Samples sent to Mesa County Exceeded 6 hr hold time.

Zancanella & Associates, Inc.

Hot Springs Pool

September 2014 Coliform Summary

Permit Number: COG600308

Prepared By: MVW

Location: Main Pool

Date	Parameter Measurement		
	Fecal	E Coli	Total Coliform
	Colonies/100ml	Colonies/100ml	Colonies/100ml
9/3/2014	0	0	1
9/10/2014	1	0	0
9/17/2014	0	1	2
9/24/2014	1	2	16
Average	0.316	0.376	1.337

Location: Therapy Pool

Date	Parameter Measurement		
	Fecal	E Coli	Total Coliform
	Colonies/100ml	Colonies/100ml	Colonies/100ml
9/3/2014	0	0	1
9/10/2014	0	0	1
9/17/2014	1	1	1
9/24/2014	1	0	0
Average	0.316	0.178	0.562

Limits		
Fecal	E Coli	Total Coliform
>1 per 100ml	235 per 100ml	20,000 per 100ml

Zancanella & Associates, Inc.

Hot Springs Pool October 2014 Coliform Summary

Permit Number: COG600308
Prepared By: MVW

Location: Main Pool


Date	Parameter Measurement		
	Fecal	E Coli	Total Coliform
	Colonies/100ml	Colonies/100ml	Colonies/100ml
10/1/2014	0	1	1
10/8/2014	0	0	0
10/15/2014			
10/22/2014			
10/29/2014			
Average	0.100	0.316	0.316

Location: Therapy Pool


Date	Parameter Measurement		
	Fecal	E Coli	Total Coliform
	Colonies/100ml	Colonies/100ml	Colonies/100ml
10/1/2014	1	0	0
10/8/2014	0	0	0
10/15/2014			
10/22/2014			
10/29/2014			
Average	0.316	0.100	0.100

Limits		
Fecal	E Coli	Total Coliform
>1 per 100ml	235 per 100ml	20,000 per 100ml


Glenwood Hot Springs Therapy Pool - August 2014 Free Chlorine Residual

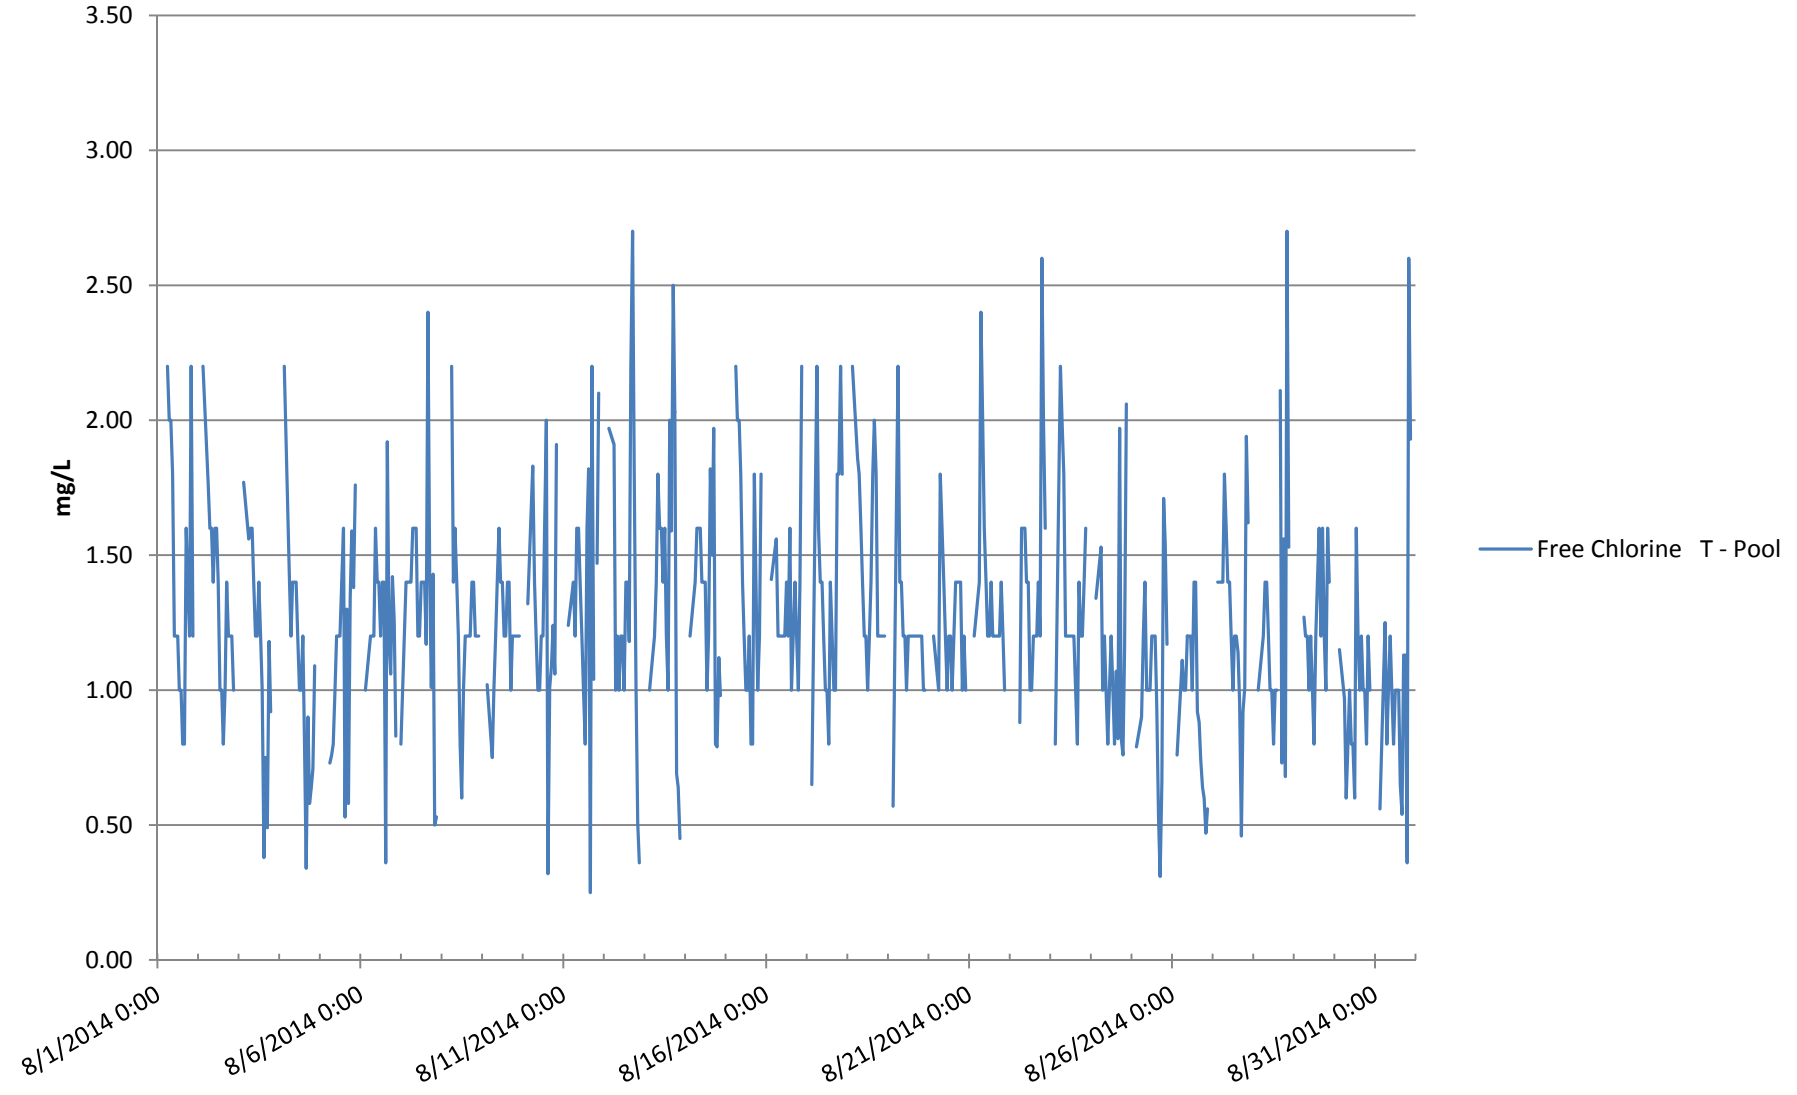


Glenwood Hot Springs Therapy Pool - September 2014 Free Chlorine Residual

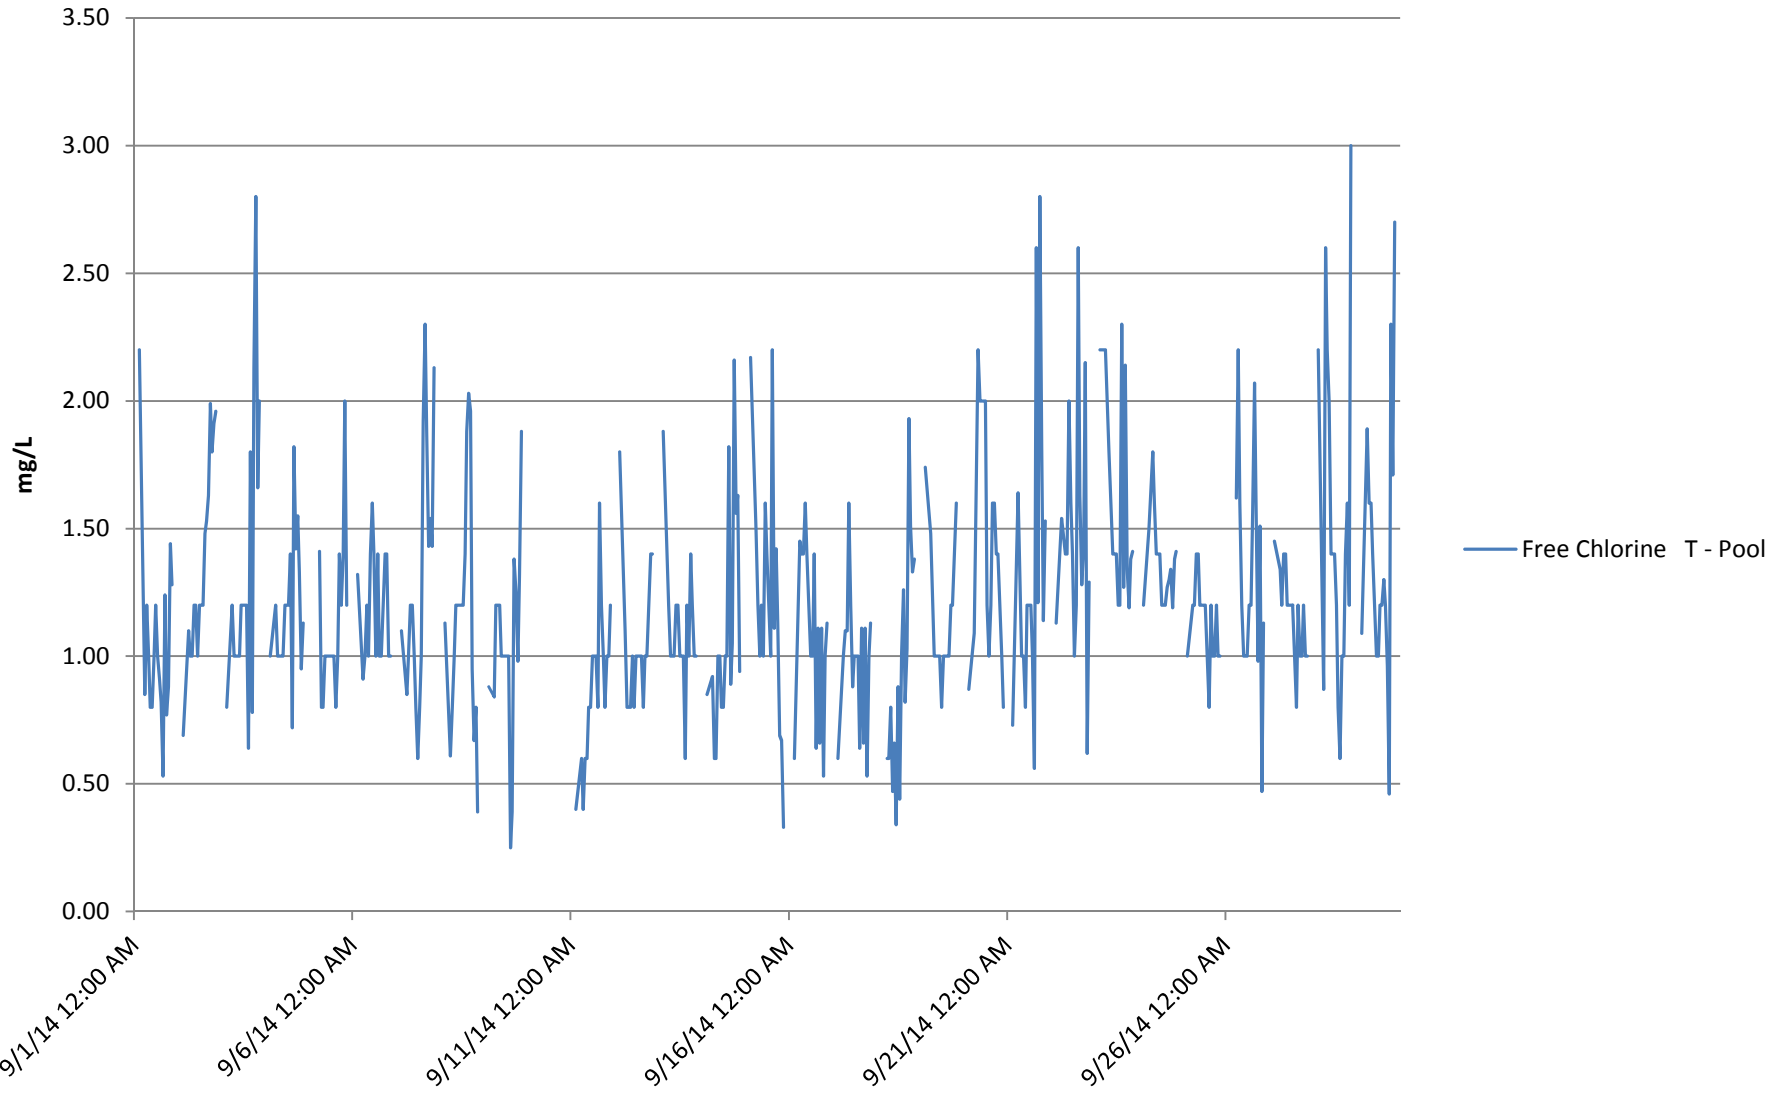


Glenwood Hot Springs Therapy Pool - October 2014 Free Chlorine Residual

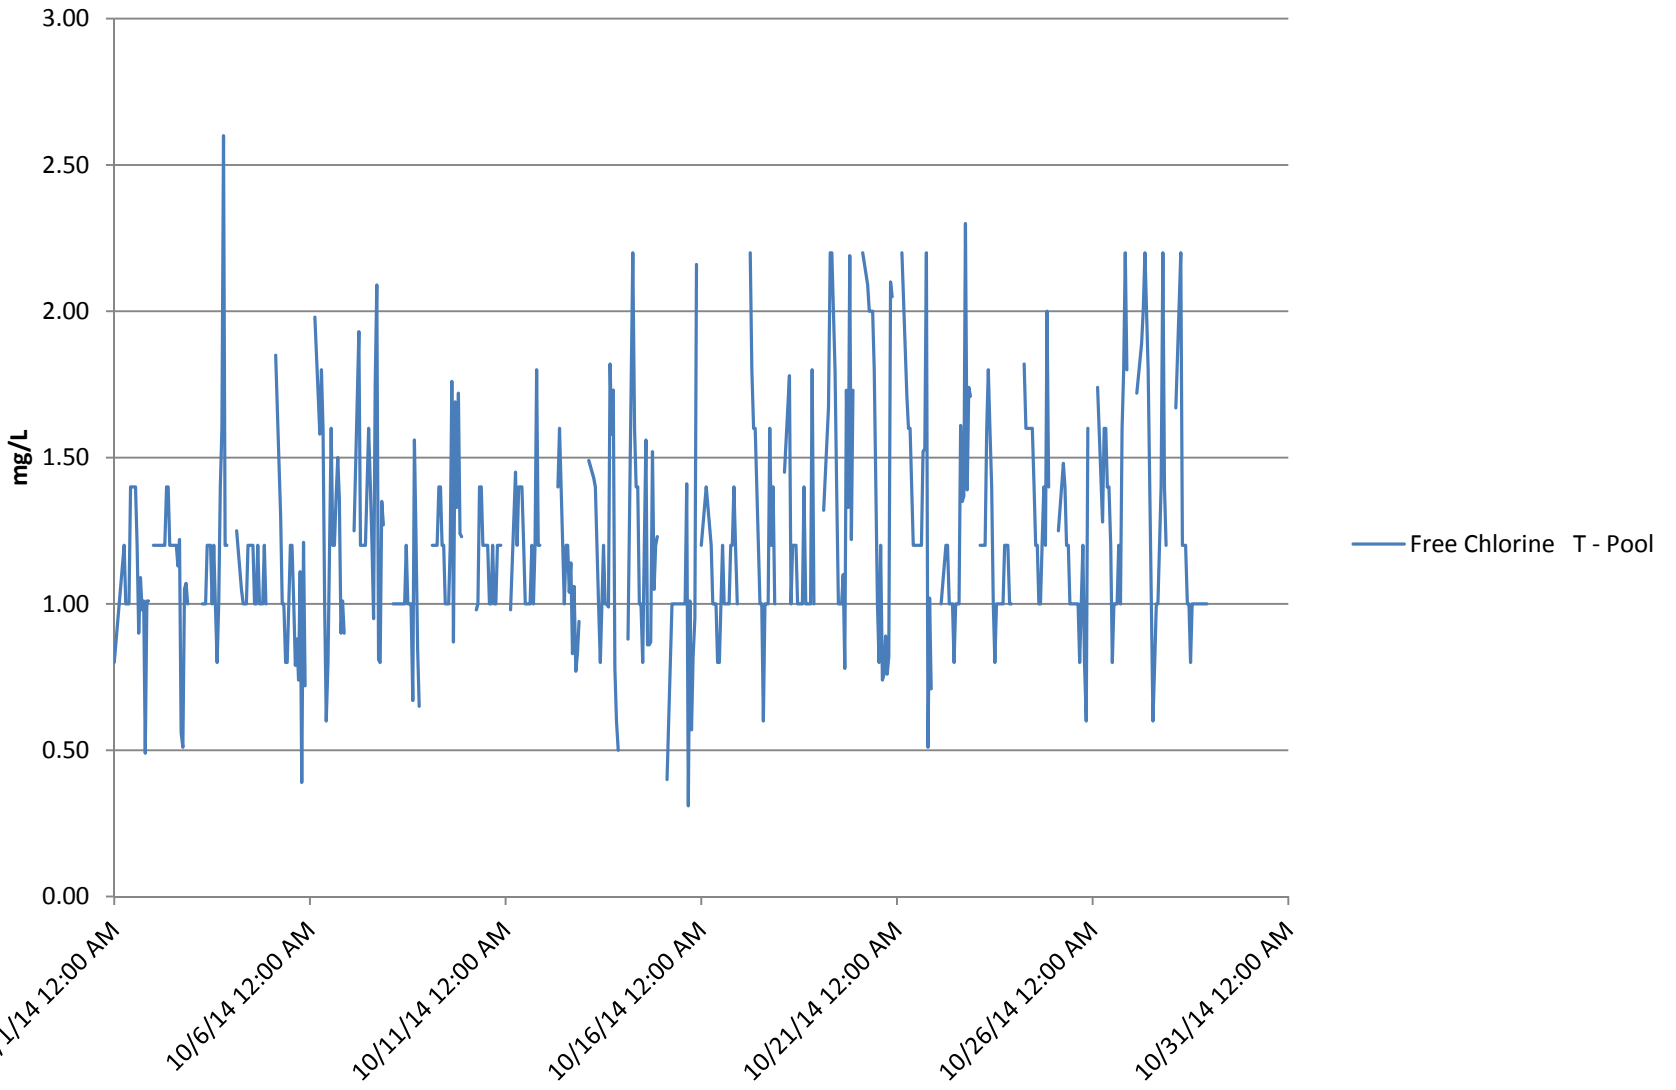


Glenwood Hot Springs Main Pool - August 2014 Free Chlorine Residual

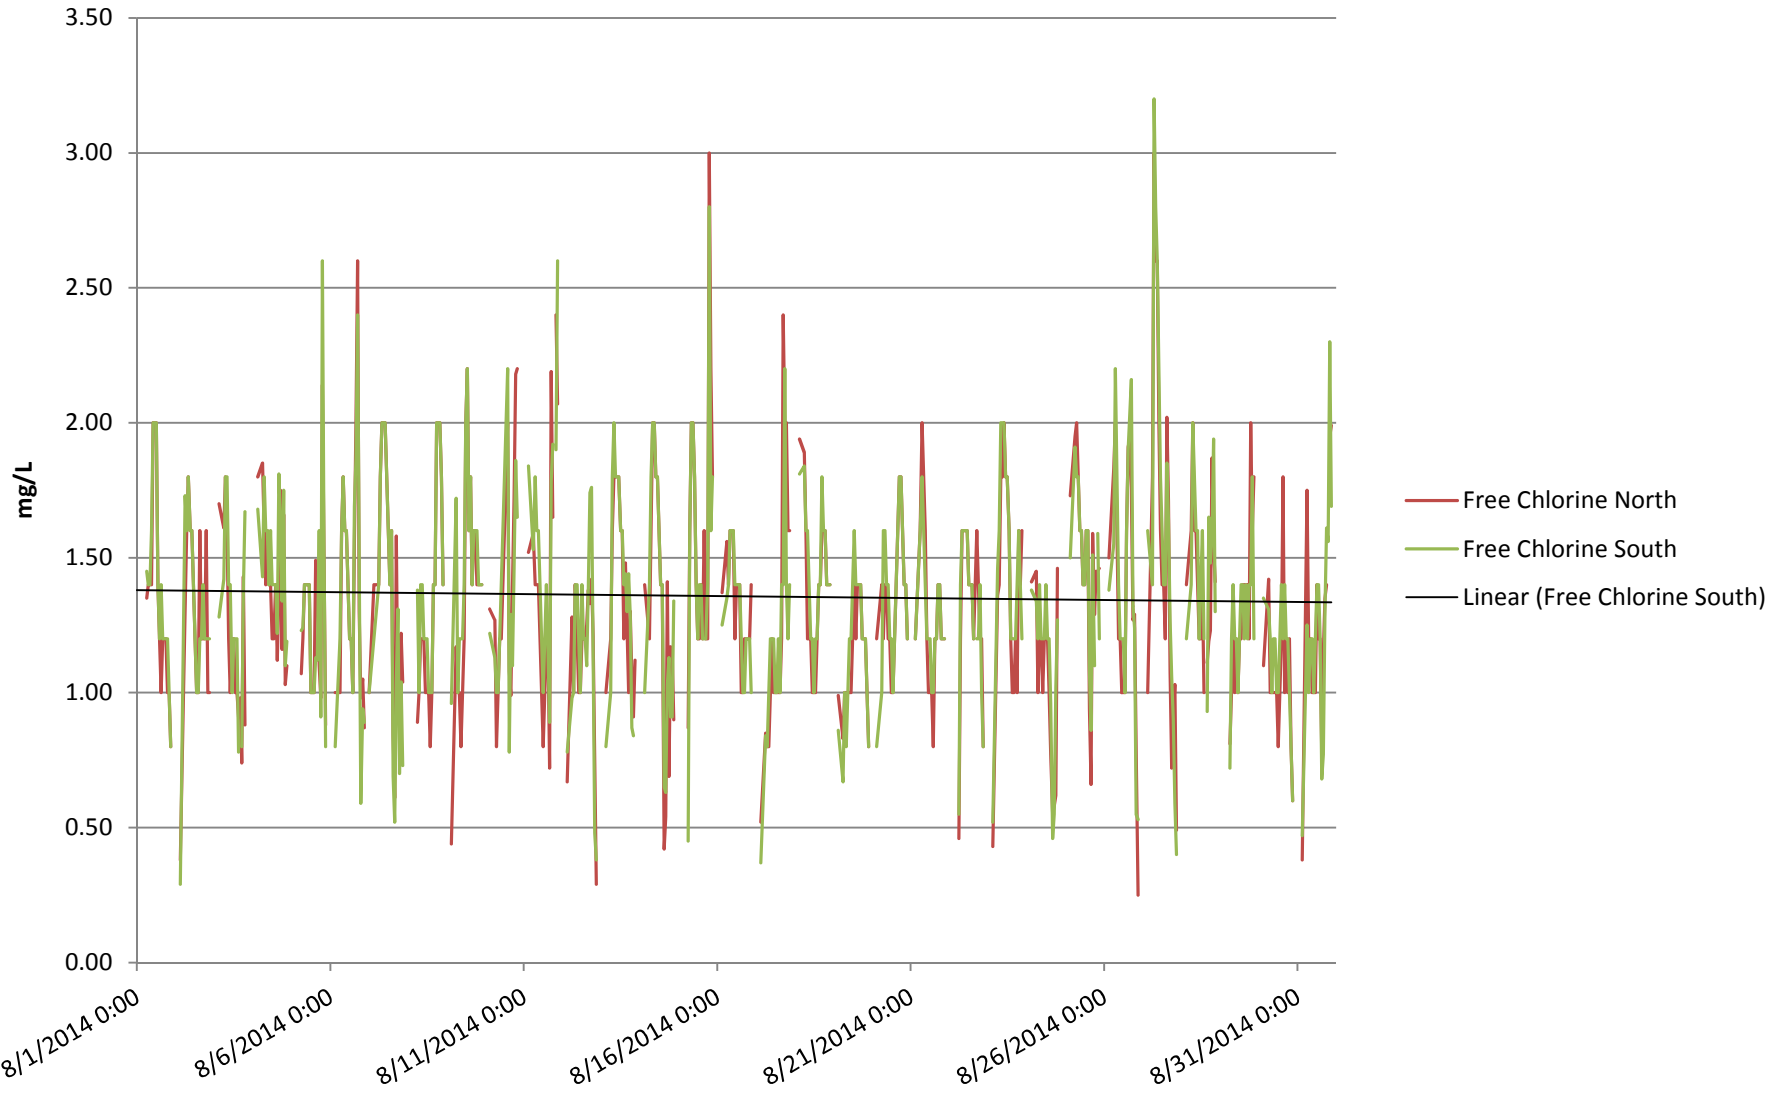

Glenwood Hot Springs Main Pool - September 2014 Free Chlorine Residual

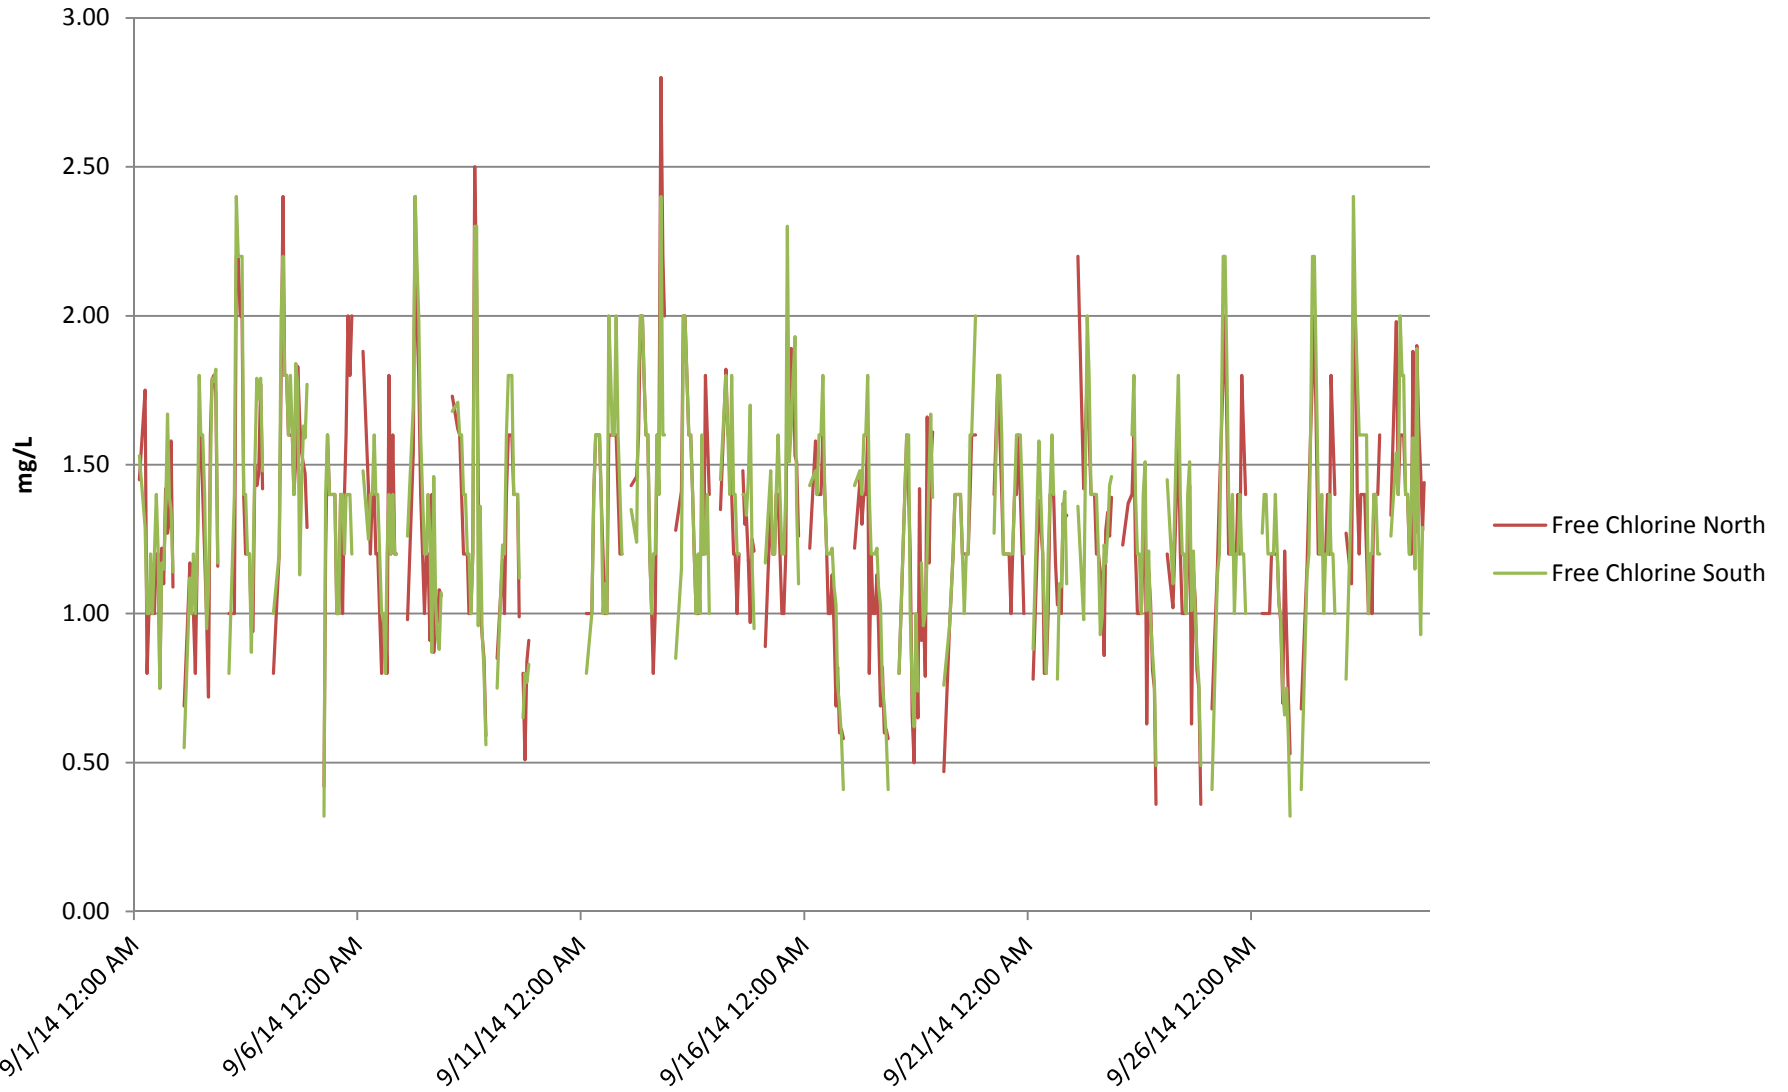

Glenwood Hot Springs Main Pool - October 2014 Free Chlorine Residual

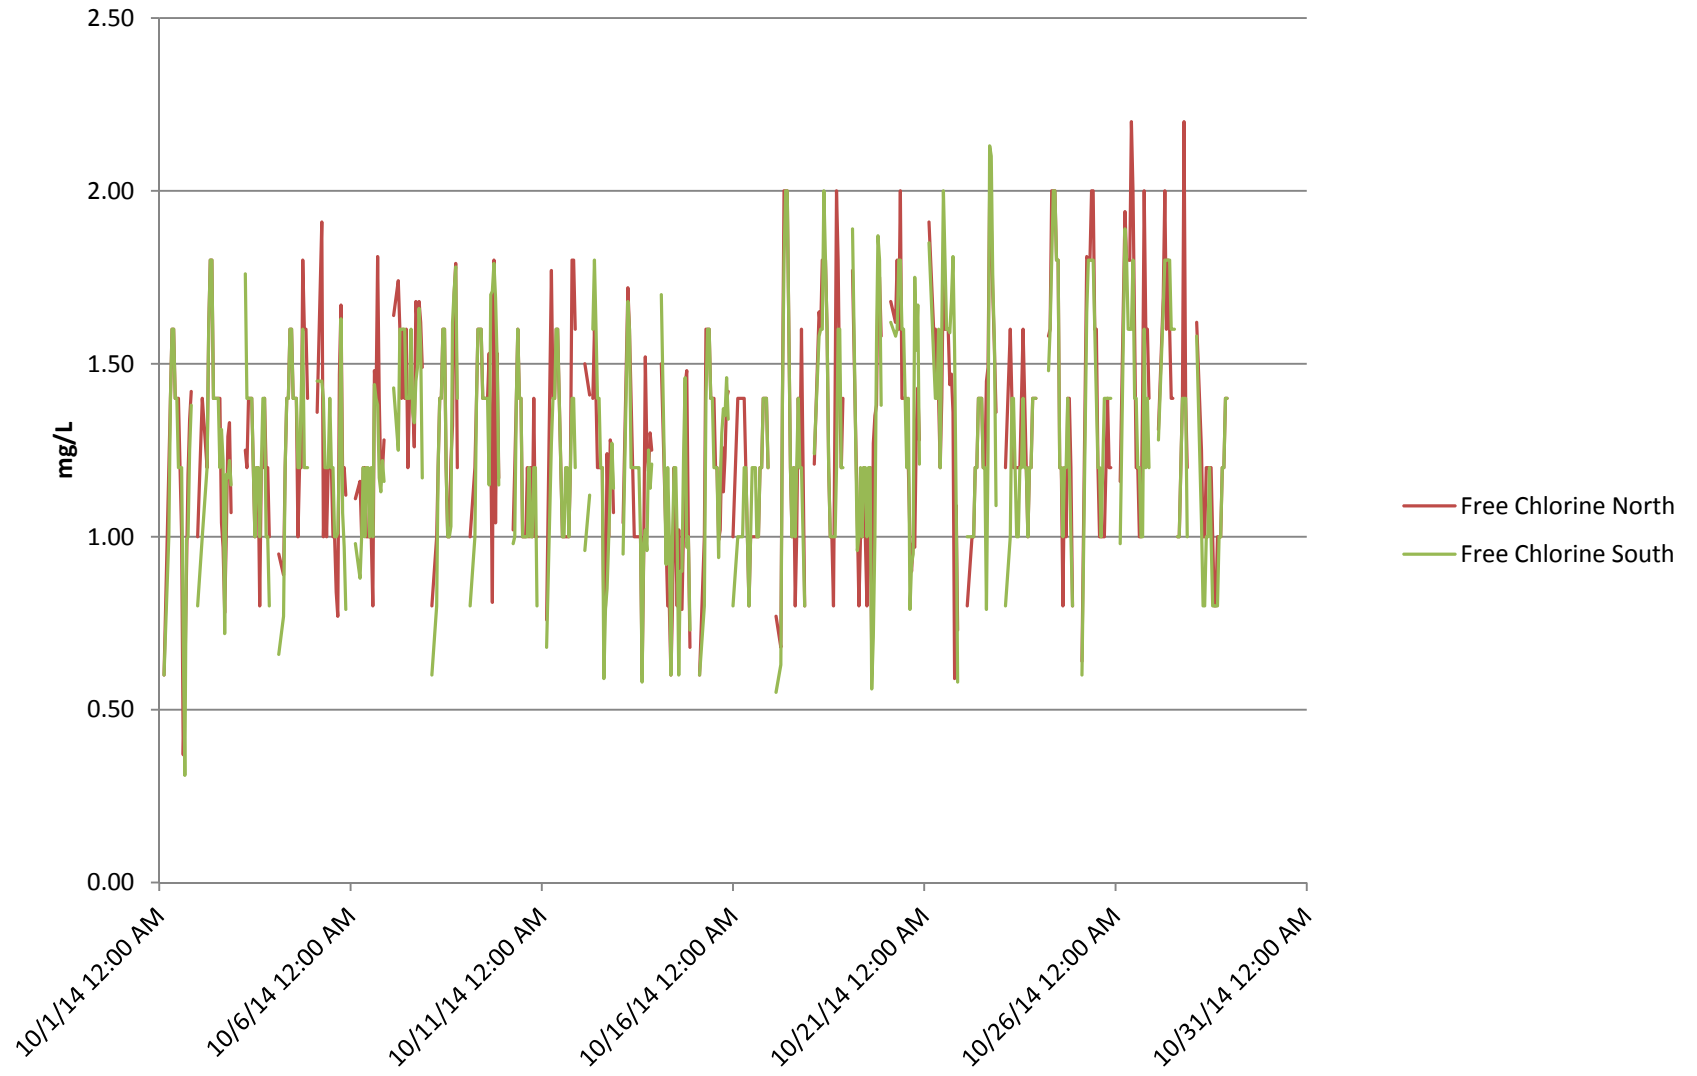

GLENWOOD HOT SPRINGS
POOL MAINTENANCE DEPT.

OPERATOR'S DAILY LOG

August 2014

Date Time	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Kiddie Free Chlorine	Combined Chlorine M-Pool	Combined Chlorine T-Pool	Operator Initials
8/1/2014 0:00				X			
8/1/2014 3:00				X			
8/1/2014 6:00	2.20	1.35	1.45	X			SD
8/1/2014 7:00	2.00	1.40	1.40	X			MG
8/1/2014 8:00	2.00	1.40	1.40	X	0.2	0.2	MG
8/1/2014 9:00	1.80	1.40	1.60	X			MG
8/1/2014 10:00	1.20	2.00	2.00	1.60			MG
8/1/2014 11:00	1.20	2.00	2.00	2.20			MG
8/1/2014 12:00	1.20	2.00	2.00	2.40	0.1	0.2	MG
8/1/2014 13:00	1.00	1.40	1.40	2.80			MG
8/1/2014 14:00	1.00	1.20	1.20	2.80			MG
8/1/2014 15:00	0.80	1.00	1.40	1.60			BJR
8/1/2014 16:00	0.80	1.20	1.20	1.80			BJR
8/1/2014 17:00	1.60	1.20	1.20	2.40	0.1	0.0	BJR
8/1/2014 18:00	1.40	1.20	1.20	X			BJR
8/1/2014 19:00	1.20	1.00	1.20	X			BJR
8/1/2014 20:00	2.20	1.00	1.00	X			BJR
8/1/2014 21:00	1.20	0.80	0.80	X			BJR
8/1/2014 22:00				X			BJR
8/2/2014 0:00				X			
8/2/2014 3:00	2.20	0.38	0.29	X			SD
8/2/2014 6:00	1.77	1.31	1.73	X			SD
8/2/2014 7:00	1.60	1.60	1.60	X			MG
8/2/2014 8:00	1.60	1.80	1.80	X	0.2	0.2	MG
8/2/2014 9:00	1.40	1.60	1.60	1.00			MG
8/2/2014 10:00	1.60	1.60	1.60	1.40			MG
8/2/2014 11:00	1.60	1.40	1.40	1.40			MG
8/2/2014 12:00	1.40	1.20	1.20	1.40	0.1	0.2	MG
8/2/2014 13:00	1.00	1.00	1.00	1.20			MG
8/2/2014 14:00	1.00	1.00	1.00	1.20			MG
8/2/2014 15:00	0.80	1.60	1.20	1.00			BJR
8/2/2014 16:00	1.00	1.20	1.20	1.00			BJR
8/2/2014 17:00	1.40	1.20	1.40	1.60	0.1	0.1	BJR
8/2/2014 18:00	1.20	1.20	1.20	X			BJR
8/2/2014 19:00	1.20	1.60	1.20	X			BJR
8/2/2014 20:00	1.20	1.00	1.20	X			BJR
8/2/2014 21:00	1.00	1.00	1.20	X			BJR
8/2/2014 22:00				X			BJR
8/3/2014 12:00				X			
8/3/2014 3:00	1.77	1.70	1.28	X			SD
8/3/2014 6:00	1.56	1.61	1.42	X			SD
8/3/2014 7:00	1.60	1.80	1.80	X			MW
8/3/2014 8:00	1.60	1.60	1.80	X	0.2	0.2	MW
8/3/2014 9:00	1.40	1.20	1.40	1.80			MW
8/3/2014 10:00	1.20	1.00	1.40	2.40			MW
8/3/2014 11:00	1.20	1.20	1.00	2.40			MW
8/3/2014 12:00	1.40	1.20	1.20	2.20	0.2	0.2	MW
8/3/2014 13:00	1.20	1.00	1.20	2.00			MW
8/3/2014 14:00	1.00	1.00	1.20	1.60			MW
8/3/2014 15:00	0.38	0.91	0.78	1.18			LG
8/3/2014 16:00	0.75	0.98		1.77			LG
8/3/2014 17:00	0.49	0.74	0.80	0.91	0.2	0.4	LG
8/3/2014 18:00	1.18	1.43	1.37	X			LG
8/3/2014 19:00	0.92	0.88	1.67	X			LG
8/3/2014 20:00				X			LG
8/3/2014 21:00	0.52	1.31	1.05	X			LG
8/3/2014 22:00				X			LG
8/4/2014 0:00				X			
8/4/2014 3:00	2.20	1.80	1.68	X			SD

GLENWOOD HOT SPRINGS
 POOL MAINTENANCE DEPT.

OPERATOR'S DAILY LOG

August 2014

Date Time	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Kiddie Free Chlorine	Combined Chlorine M-Pool	Combined Chlorine T-Pool	Operator Initials
8/4/2014 6:00	1.44	1.85	1.43	X			SD
8/4/2014 7:00	1.20	1.60	1.80	X			MW
8/4/2014 8:00	1.40	1.40	1.60	X	0.0	0.0	MW
8/4/2014 9:00	1.40	1.60	1.60	2.20			MW
8/4/2014 10:00	1.40	1.40	1.40	2.60			MW
8/4/2014 11:00	1.20	1.40	1.60	3.00			MW
8/4/2014 12:00	1.00	1.20	1.40	2.60	0.2	0.2	MW
8/4/2014 13:00	1.00	1.20	1.40	2.40			MW
8/4/2014 14:00	1.20	1.40	1.40	2.20			MW
8/4/2014 15:00	0.82	1.12	1.22	1.73			LG
8/4/2014 16:00	0.34	1.36	1.81	0.25			LG
8/4/2014 17:00	0.90	1.75	1.64	0.25	0.2	0.1	LG
8/4/2014 18:00	0.58	1.16	1.34	X			LG
8/4/2014 19:00	0.64	1.66	1.75	X			LG
8/4/2014 20:00	0.71	1.03	1.10	X			LG
8/4/2014 21:00	1.09	1.10	1.19	X			LG
8/4/2014 22:00				X			LG
8/5/2014 0:00				X			
8/5/2014 3:00				X			SD
8/5/2014 6:00	0.73	1.07	1.23	X			SD
8/5/2014 7:00	0.76	1.20	1.24	X			MG
8/5/2014 8:00	0.80	1.40	1.40	X	0.1	0.2	MG
8/5/2014 9:00	1.00	1.40	1.40	0.40			MG
8/5/2014 10:00	1.20	1.40	1.40	0.40			MG
8/5/2014 11:00	1.20	1.40	1.40	0.60			MG
8/5/2014 12:00	1.20	1.00	1.00	1.60	0.1	0.1	MG
8/5/2014 13:00	1.40	1.00	1.00	X			MG
8/5/2014 14:00	1.60	1.00	1.00	X			MG
8/5/2014 15:00	0.53	1.49	1.13	X			LG
8/5/2014 16:00	1.30	1.45	1.12	X			LG
8/5/2014 17:00	0.58	1.10	1.60	X	0.1	0.3	LG
8/5/2014 18:00	1.34	0.98	0.91	X			LG
8/5/2014 19:00	1.59	2.14	2.60	X			LG
8/5/2014 20:00	1.38	1.51	1.54	X			LG
8/5/2014 21:00	1.76	0.88	0.80	X			LG
8/5/2014 22:00				X			LG
8/6/2014 0:00				X			BJR
8/6/2014 3:00	1.00	1.00	0.80	X			BJR
8/6/2014 6:00	1.20	1.00	1.20	X			BJR
8/6/2014 7:00	1.20	1.60	1.60	X			MG
8/6/2014 8:00	1.20	1.80	1.80	X	0.2	0.2	MG
8/6/2014 9:00	1.60	1.60	1.60	1.00			MG
8/6/2014 10:00	1.40	1.60	1.60	1.20			MG
8/6/2014 11:00	1.40	1.40	1.40	1.40			MG
8/6/2014 12:00	1.20	1.20	1.20	1.40	0.1	0.2	MG
8/6/2014 13:00	1.40	1.20	1.20	1.40			MG
8/6/2014 14:00	1.40	1.00	1.00	1.40			MG
8/6/2014 15:00	0.36	1.56	1.69	1.27			LG
8/6/2014 16:00	1.92	2.01	1.87	2.90			LG
8/6/2014 17:00	1.18	2.60	2.40	3.60	0.2	0.2	LG
8/6/2014 18:00	1.06	1.30	1.49	X			LG
8/6/2014 19:00	1.42	0.98	0.59	X			LG
8/6/2014 20:00	1.26	1.05	0.94	X			LG
8/6/2014 21:00	0.83	0.87	0.89	X			LG
8/6/2014 22:00				X			LG
8/7/2014 0:00	0.80	1.00	1.00	X			BJR
8/7/2014 3:00	1.40	1.40	1.20	X			BJR
8/7/2014 6:00	1.40	1.40	1.40	X			BJR
8/7/2014 7:00	1.60	1.80	1.80	X			MG

GLENWOOD HOT SPRINGS
 POOL MAINTENANCE DEPT.

OPERATOR'S DAILY LOG

August 2014

Date Time	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Kiddie Free Chlorine	Combined Chlorine M-Pool	Combined Chlorine T-Pool	Operator Initials
8/7/2014 8:00	1.60	2.00	2.00	X	0.2	0.2	MG
8/7/2014 9:00	1.60	2.00	2.00	0.80			MG
8/7/2014 10:00	1.20	2.00	2.00	1.00			MG
8/7/2014 11:00	1.20	1.80	1.80	1.40			MG
8/7/2014 12:00	1.40	1.60	1.60	1.80	0.1	0.2	MG
8/7/2014 13:00	1.40	1.40	1.40	2.00			MG
8/7/2014 14:00	1.40	1.60	1.60	1.80			MG
8/7/2014 15:00	1.17	0.84	0.69	1.46			LG
8/7/2014 16:00	2.40	0.61	0.52	0.43			LG
8/7/2014 17:00	1.41	1.58	1.04	X	0.1	0.4	LG
8/7/2014 18:00	1.01	0.93	1.31	X			LG
8/7/2014 19:00	1.43	0.97	0.70	X			LG
8/7/2014 20:00	0.50	1.22	1.04	X			LG
8/7/2014 21:00	0.53	1.04	0.73	X			LG
8/7/2014 22:00				X			LG
8/8/2014 0:00				X			
8/8/2014 3:00				X			
8/8/2014 6:00	2.20	0.89	1.38	X			SD
8/8/2014 7:00	1.40	1.00	1.00	X			MW
8/8/2014 8:00	1.60	1.20	1.40	X	0.2	0.2	MW
8/8/2014 9:00	1.40	1.20	1.40	2.00			MW
8/8/2014 10:00	1.20	1.20	1.20	1.80			MW
8/8/2014 11:00	0.80	1.00	1.20	1.80			MW
8/8/2014 12:00	0.60	1.00	1.20	1.60	0.2	0.2	MW
8/8/2014 13:00	1.00	1.00	1.00	1.40			MW
8/8/2014 14:00	1.20	0.80	1.00	1.20			MW
8/8/2014 15:00	1.20	1.00	1.00	1.20			MG
8/8/2014 16:00	1.20	1.40	1.40	1.00			MG
8/8/2014 17:00	1.20	1.40	1.40	X	0.1	0.2	MG
8/8/2014 18:00	1.40	2.00	2.00	X			MG
8/8/2014 19:00	1.40	2.00	2.00	X			MG
8/8/2014 20:00	1.20	2.00	2.00	X			MG
8/8/2014 21:00	1.20	1.80	1.80	X			MG
8/8/2014 22:00	1.20	1.40	1.40	X			MG
8/9/2014 0:00				X			
8/9/2014 3:00	1.02	0.44	0.96	X			SD
8/9/2014 6:00	0.75	1.17	1.72	X			SD
8/9/2014 7:00	1.00	1.00	1.00	X			MW
8/9/2014 8:00	1.20	1.00	1.20	X	0.2	0.2	MW
8/9/2014 9:00	1.40	0.80	1.20	2.20			MW
8/9/2014 10:00	1.60	1.00	1.20	2.60			MW
8/9/2014 11:00	1.40	1.20	1.40	2.40			MW
8/9/2014 12:00	1.40	2.00	2.00	1.80	0.0	0.0	MW
8/9/2014 13:00	1.20	2.20	2.20	1.40			MW
8/9/2014 14:00	1.20	1.60	1.60	1.20			MW
8/9/2014 15:00	1.40	1.80	1.80	1.60			MG
8/9/2014 16:00	1.40	1.40	1.40	1.40			MG
8/9/2014 17:00	1.00	1.60	1.60	1.60	0.0	0.0	MG
8/9/2014 18:00	1.20	1.60	1.60	X			MG
8/9/2014 19:00	1.20	1.40	1.60	X			MG
8/9/2014 20:00	1.20	1.40	1.40	X			MG
8/9/2014 21:00	1.20	1.40	1.40	X			MG
8/9/2014 22:00	1.20	1.40	1.40	X			MG
8/10/2014 0:00				X			
8/10/2014 3:00	1.32	1.31	1.22	X			SD
8/10/2014 6:00	1.83	1.27	1.13	X			SD
8/10/2014 7:00	1.40	0.80	1.00	X			MW
8/10/2014 8:00	1.20	1.00	1.00	X	0.2	0.2	MW
8/10/2014 9:00	1.00	1.20	1.20	1.40			MW

GLENWOOD HOT SPRINGS
 POOL MAINTENANCE DEPT.

OPERATOR'S DAILY LOG

August 2014

Date Time	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Kiddie Free Chlorine	Combined Chlorine M-Pool	Combined Chlorine T-Pool	Operator Initials
8/10/2014 10:00	1.00	1.20	1.40	2.20			MW
8/10/2014 11:00	1.20	1.40	1.60	1.80			MW
8/10/2014 12:00	1.20	1.60	1.80	1.60	0.2	0.2	MW
8/10/2014 13:00	1.60	1.80	2.00	1.60			MW
8/10/2014 14:00	2.00	2.00	2.20	2.00			MW
8/10/2014 15:00	0.32	1.08	0.78	1.76			LG
8/10/2014 16:00	1.01	0.99	1.29	2.60			LG
8/10/2014 17:00	1.09	1.39	1.10	1.80	0.3	0.1	LG
8/10/2014 18:00	1.24	1.72	1.46	X			LG
8/10/2014 19:00	1.06	2.18	1.86	3.70			LG
8/10/2014 20:00	1.91	2.20	1.65	X			LG
8/10/2014 21:00				X			LG
8/10/2014 22:00				X			LG
8/11/2014 0:00				X			
8/11/2014 3:00	1.24	1.52	1.84	X			SD
8/11/2014 6:00	1.40	1.59	1.53	X			SD
8/11/2014 7:00	1.20	1.40	1.80	X			MW
8/11/2014 8:00	1.60	1.40	1.60	X	0.2	0.2	MW
8/11/2014 9:00	1.60	1.40	1.60	1.20			MW
8/11/2014 10:00	1.40	1.20	1.40	1.60			MW
8/11/2014 11:00	1.20	1.00	1.20	2.40			MW
8/11/2014 12:00	1.00	0.80	1.00	2.20	0.2	0.2	MW
8/11/2014 13:00	0.80	1.00	1.20	1.80			MW
8/11/2014 14:00	1.60	1.20	1.40	1.20			MW
8/11/2014 15:00	1.82	1.19	1.15	1.57			LG
8/11/2014 16:00	0.25	0.72	0.89	1.54			LG
8/11/2014 17:00	2.20	2.19	1.78	2.80	0.1	0.1	LG
8/11/2014 18:00	1.04	1.65	1.92	X			LG
8/11/2014 19:00				X			LG
8/11/2014 20:00	1.47	2.40	1.90	X			LG
8/11/2014 21:00	2.10	2.07	2.60	X			LG
8/11/2014 22:00				X			LG
8/12/2014 0:00				X			
8/12/2014 3:00	1.97	0.67	0.78	X			SD
8/12/2014 6:00	1.91	1.28	0.98	X			SD
8/12/2014 7:00	1.00	1.00	1.00	X			MW
8/12/2014 8:00	1.20	1.40	1.40	X	0.2	0.2	MW
8/12/2014 9:00	1.00	1.20	1.40	1.80			MW
8/12/2014 10:00	1.20	1.00	1.20	2.00			MW
8/12/2014 11:00	1.20	1.00	1.00	2.40			MW
8/12/2014 12:00	1.00	1.20	1.40	2.00	0.2	0.2	MW
8/12/2014 13:00	1.40	1.20	1.20	1.60			MW
8/12/2014 14:00	1.40	1.20	1.20	2.00			MW
8/12/2014 15:00	1.18	1.25	1.10	1.71			LG
8/12/2014 16:00	2.20	1.38	1.39	3.10			LG
8/12/2014 17:00	2.70	1.33	1.74	3.10	0.4	0.2	LG
8/12/2014 18:00	1.82	1.42	1.76	X			LG
8/12/2014 19:00	1.03	1.21	1.15	X			LG
8/12/2014 20:00	0.51	0.75	0.48	X			LG
8/12/2014 21:00	0.36	0.29	0.38	X			LG
8/12/2014 22:00				X			LG
8/13/2014 0:00				X			BJR
8/13/2014 3:00	1.00	1.00	0.80	X			BJR
8/13/2014 6:00	1.20	1.20	1.00	X			BJR
8/13/2014 7:00	1.40	1.60	1.80	X			MG
8/13/2014 8:00	1.80	1.80	2.00	X	0.2	0.2	MG
8/13/2014 9:00	1.60	1.80	1.80	0.80			MG
8/13/2014 10:00	1.60	1.80	1.80	1.40			MG
8/13/2014 11:00	1.40	1.80	1.80	1.80			MG

GLENWOOD HOT SPRINGS
POOL MAINTENANCE DEPT.

OPERATOR'S DAILY LOG

August 2014

Date Time	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Kiddie Free Chlorine	Combined Chlorine M-Pool	Combined Chlorine T-Pool	Operator Initials
8/13/2014 12:00	1.60	1.60	1.60	2.00	0.1	0.2	MG
8/13/2014 13:00	1.20	1.60	1.60	1.80			MG
8/13/2014 14:00	1.00	1.20	1.40	2.00			MG
8/13/2014 15:00	2.00	1.48	1.44	2.50			LG
8/13/2014 16:00	1.59	1.24	1.30	3.00			LG
8/13/2014 17:00	2.50	1.00	1.44	1.69	0.1	0.1	LG
8/13/2014 18:00	2.03	1.30	1.29	X			LG
8/13/2014 19:00	0.69	1.06	0.87	X			LG
8/13/2014 20:00	0.64	0.91	0.84	X			LG
8/13/2014 21:00	0.45	1.12		X			LG
8/13/2014 22:00				X			LG
8/14/2014 0:00				X			BJR
8/14/2014 3:00	1.20	1.40	1.00	X			BJR
8/14/2014 6:00	1.40	1.20	1.40	X			BJR
8/14/2014 7:00	1.60	1.60	1.80	X			MG
8/14/2014 8:00	1.60	2.00	2.00	X	0.2	0.2	MG
8/14/2014 9:00	1.60	2.00	2.00	0.80			MG
8/14/2014 10:00	1.40	1.80	1.80	1.20			MG
8/14/2014 11:00	1.40	1.80	1.80	1.40			MG
8/14/2014 12:00	1.40	1.60	1.60	1.80	0.1	0.2	MG
8/14/2014 13:00	1.00	1.40	1.40	1.60			MG
8/14/2014 14:00	1.20	1.40	1.40	1.40			MG
8/14/2014 15:00	1.82	0.42	0.65	2.90			LG
8/14/2014 16:00	1.50	0.54	0.63	3.50			LG
8/14/2014 17:00	1.97	1.41	1.03	X	0.1	0.2	LG
8/14/2014 18:00	0.80	0.69	1.13	X			LG
8/14/2014 19:00	0.79	1.17	0.91	X			LG
8/14/2014 20:00	1.12	1.16	0.91	X			LG
8/14/2014 21:00	0.98	0.90	1.34	X			LG
8/14/2014 22:00				X			LG
8/15/2014 0:00				X			
8/15/2014 3:00				X			
8/15/2014 6:00	2.20	0.87	0.45	X			SD
8/15/2014 7:00	2.00	1.60	1.60	X			MG
8/15/2014 8:00	2.00	2.00	2.00	X	0.2	0.2	MG
8/15/2014 9:00	1.80	2.00	2.00	0.60			MG
8/15/2014 10:00	1.40	1.80	1.80	1.40			MG
8/15/2014 11:00	1.20	1.40	1.40	1.40			MG
8/15/2014 12:00	1.00	1.20	1.20	1.00	0.1	0.2	MG
8/15/2014 13:00	1.00	1.20	1.40	1.20			MG
8/15/2014 14:00	1.20	1.40	1.40	1.40			MG
8/15/2014 15:00	0.80	1.20	1.20	1.20			BJR
8/15/2014 16:00	0.80	1.60	1.20	1.60			BJR
8/15/2014 17:00	1.80	1.20	1.20	2.00	0.1	0.1	BJR
8/15/2014 18:00	1.40	1.20	1.40	X			BJR
8/15/2014 19:00	1.00	3.00	2.80	X			BJR
8/15/2014 20:00	1.20	2.20	1.60	X			BJR
8/15/2014 21:00	1.80	1.80	1.80	X			BJR
8/15/2014 22:00				X			BJR
8/16/2014 0:00				X			
8/16/2014 3:00	1.41	1.37	1.25	X			SD
8/16/2014 6:00	1.56	1.56	1.35	X			SD
8/16/2014 7:00	1.20	1.40	1.40	X			MG
8/16/2014 8:00	1.20	1.60	1.60	X	0.1	0.2	MG
8/16/2014 9:00	1.20	1.60	1.60	0.80			MG
8/16/2014 10:00	1.20	1.60	1.60	1.40			MG
8/16/2014 11:00	1.20	1.20	1.40	2.20			MG
8/16/2014 12:00	1.40	1.40	1.40	2.00	0.2	0.2	MG
8/16/2014 13:00	1.20	1.40	1.40	2.00			MG

GLENWOOD HOT SPRINGS
 POOL MAINTENANCE DEPT.

OPERATOR'S DAILY LOG

August 2014

Date Time	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Kiddie Free Chlorine	Combined Chlorine M-Pool	Combined Chlorine T-Pool	Operator Initials
8/16/2014 14:00	1.60	1.40	1.40	1.60			MG
8/16/2014 15:00	1.00	1.00	1.20	AFR			BJR
8/16/2014 16:00	1.20	1.00	1.00	X			BJR
8/16/2014 17:00	1.40	1.20	1.00	X	0.1	0.1	BJR
8/16/2014 18:00	1.20	1.20	1.20	X			BJR
8/16/2014 19:00	1.00	1.20	1.20	X			BJR
8/16/2014 20:00	1.40	1.20	1.20	X			BJR
8/16/2014 21:00	2.20	1.40	1.00	X			BJR
8/16/2014 22:00				X			BJR
8/17/2014 0:00				X			
8/17/2014 3:00	0.65	0.52	0.37	X			SD
8/17/2014 6:00	2.20	0.85	0.84	X			SD
8/17/2014 7:00	1.60	0.80	0.80	X			MW
8/17/2014 8:00	1.40	0.80	1.00	X	0.2	0.2	MW
8/17/2014 9:00	1.40	1.00	1.20	1.40			MW
8/17/2014 10:00	1.20	1.20	1.20	1.60			MW
8/17/2014 11:00	1.00	1.00	1.20	1.80			MW
8/17/2014 12:00	1.00	1.00	1.00	1.80	0.2	0.2	MW
8/17/2014 13:00	0.80	1.00	1.00	1.60			MW
8/17/2014 14:00	1.40	1.00	1.20	1.60			MW
8/17/2014 15:00	1.20	1.00	1.00	1.20			BJR
8/17/2014 16:00	1.00	1.20	1.40	1.40			BJR
8/17/2014 17:00	1.00	2.40	1.40	1.60	0.1	0.1	BJR
8/17/2014 18:00	1.80	2.00	2.20	X			BJR
8/17/2014 19:00	1.80	2.00	1.40	X			BJR
8/17/2014 20:00	2.20	1.60	1.20	X			BJR
8/17/2014 21:00	1.80	1.60	1.40	X			BJR
8/17/2014 22:00				X			BJR
8/18/2014 0:00				X			
8/18/2014 3:00	2.20	1.94	1.81	X			SD
8/18/2014 6:00	1.86	1.89	1.84	X			SD
8/18/2014 7:00	1.80	1.60	1.60	X			MW
8/18/2014 8:00	1.60	1.20	1.60	X	0.2	0.2	MW
8/18/2014 9:00	1.40	1.20	1.40	1.60			MW
8/18/2014 10:00	1.20	1.20	1.20	1.80			MW
8/18/2014 11:00	1.20	1.00	1.20	1.80			MW
8/18/2014 12:00	1.00	1.00	1.00	1.80	0.2	0.2	MW
8/18/2014 13:00	1.20	1.00	1.20	1.60			MW
8/18/2014 14:00	1.40	1.20	1.20	1.60			MW
8/18/2014 15:00	1.80	1.40	1.40	1.60			MG
8/18/2014 16:00	2.00	1.40	1.40	1.40			MG
8/18/2014 17:00	1.80	1.60	1.80	1.40	0.2	0.2	MG
8/18/2014 18:00	1.20	1.60	1.60	X			MG
8/18/2014 19:00	1.20	1.60	1.60	X			MG
8/18/2014 20:00	1.20	1.40	1.40	X			MG
8/18/2014 21:00	1.20	1.40	1.40	X			MG
8/18/2014 22:00	1.20	1.40	1.40	X			MG
8/19/2014 0:00				X			
8/19/2014 3:00	0.57	0.99	0.86	X			SD
8/19/2014 6:00	2.20	0.83	0.67	X			SD
8/19/2014 7:00	1.40	1.00	1.00	X			MW
8/19/2014 8:00	1.40	1.00	0.80	X	0.2	0.2	MW
8/19/2014 9:00	1.20	1.00	1.00	2.00			MW
8/19/2014 10:00	1.20	1.00	1.20	2.20			MW
8/19/2014 11:00	1.00	1.00	1.20	2.40			MW
8/19/2014 12:00	1.20	1.20	1.40	2.00	0.2	0.2	MW
8/19/2014 13:00	1.20	1.40	1.60	1.40			MW
8/19/2014 14:00	1.20	1.20	1.40	1.40			MW
8/19/2014 15:00	1.20	1.40	1.40	1.60			MG

GLENWOOD HOT SPRINGS
 POOL MAINTENANCE DEPT.

OPERATOR'S DAILY LOG

August 2014

Date Time	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Kiddie Free Chlorine	Combined Chlorine M-Pool	Combined Chlorine T-Pool	Operator Initials
8/19/2014 16:00	1.20	1.40	1.40	1.40			MG
8/19/2014 17:00	1.20	1.40	1.40	1.20	0.2	0.2	MG
8/19/2014 18:00	1.20	1.20	1.20	X			MG
8/19/2014 19:00	1.20	1.20	1.20	X			MG
8/19/2014 20:00	1.20	1.20	1.20	X			MG
8/19/2014 21:00	1.00	1.00	1.00	X			MG
8/19/2014 22:00	1.00	0.80	0.80	X			MG
8/20/2014 0:00				X			BJR
8/20/2014 3:00	1.20	1.20	0.80	X			BJR
8/20/2014 6:00	1.00	1.40	1.00	X			BJR
8/20/2014 7:00	1.80	1.20	1.60	X			MW
8/20/2014 8:00	1.60	1.40	1.60	X	0.2	0.2	MW
8/20/2014 9:00	1.40	1.40	1.40	1.40			MW
8/20/2014 10:00	1.20	1.20	1.40	2.00			MW
8/20/2014 11:00	1.00	1.20	1.20	2.00			MW
8/20/2014 12:00	1.20	1.00	1.20	2.20	0.2	0.2	MW
8/20/2014 13:00	1.20	1.00	1.00	2.40			MW
8/20/2014 14:00	1.00	1.20	1.20	2.40			MW
8/20/2014 15:00	1.20	1.40	1.40	2.00			MG
8/20/2014 16:00	1.40	1.60	1.60	2.00			MG
8/20/2014 17:00	1.40	1.80	1.80	2.00	0.2	0.2	MG
8/20/2014 18:00	1.40	1.80	1.80	X			MG
8/20/2014 19:00	1.40	1.60	1.60	X			MG
8/20/2014 20:00	1.00	1.40	1.40	X			MG
8/20/2014 21:00	1.20	1.40	1.40	X			MG
8/20/2014 22:00	1.00	1.20	1.20	X			MG
8/21/2014 0:00				X			BJR
8/21/2014 3:00	1.20	1.20	1.20	X			BJR
8/21/2014 6:00	1.40	1.60	1.60	X			BJR
8/21/2014 7:00	2.40	2.00	1.80	X			mw
8/21/2014 8:00	2.00	1.80	1.60	X	0.2	0.2	mw
8/21/2014 9:00	1.60	1.60	1.40	2.20			mw
8/21/2014 10:00	1.40	1.20	1.20	2.00			mw
8/21/2014 11:00	1.20	1.00	1.20	2.00			mw
8/21/2014 12:00	1.20	1.00	1.20	1.60	0.2	0.2	mw
8/21/2014 13:00	1.40	1.00	1.00	1.40			mw
8/21/2014 14:00	1.20	0.80	1.00	1.00			mw
8/21/2014 15:00	1.20	1.20	1.20	1.40			MG
8/21/2014 16:00	1.20	1.20	1.20	1.40			MG
8/21/2014 17:00	1.20	1.40	1.40	1.40	0.2	0.2	MG
8/21/2014 18:00	1.20	1.40	1.40	X			MG
8/21/2014 19:00	1.40	1.20	1.20	X			MG
8/21/2014 20:00	1.20	1.20	1.20	X			MG
8/21/2014 21:00	1.00	1.20	1.20	X			MG
8/21/2014 22:00				X			MG
8/22/2014 0:00				X			
8/22/2014 3:00				X			
8/22/2014 6:00	0.88	0.46	0.55	X			SD
8/22/2014 7:00	1.60	1.20	1.40	X			MG
8/22/2014 8:00	1.60	1.60	1.60	X	2.0	0.2	MG
8/22/2014 9:00	1.60	1.60	1.60	2.60			MG
8/22/2014 10:00	1.40	1.60	1.60	2.60			MG
8/22/2014 11:00	1.40	1.60	1.60	2.40			MG
8/22/2014 12:00	1.00	1.40	1.40	2.80	0.2	0.2	MG
8/22/2014 13:00	1.00	1.40	1.40	2.80			MG
8/22/2014 14:00	1.20	1.40	1.40	2.80			MG
8/22/2014 15:00	1.20	1.20	1.20	1.20			BJR
8/22/2014 16:00	1.20	1.40		1.20			BJR
8/22/2014 17:00	1.40	1.60	1.20	1.60	0.1	0.1	BJR

GLENWOOD HOT SPRINGS
POOL MAINTENANCE DEPT.

OPERATOR'S DAILY LOG

August 2014

Date Time	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Kiddie Free Chlorine	Combined Chlorine M-Pool	Combined Chlorine T-Pool	Operator Initials
8/22/2014 18:00	1.20	1.40	1.20	X			BJR
8/22/2014 19:00	2.60	1.20	1.40	X			BJR
8/22/2014 20:00	2.00	1.20	1.00	X			BJR
8/22/2014 21:00	1.60	0.80	0.80	X			BJR
8/22/2014 22:00				X			BJR
8/23/2014 0:00				X			
8/23/2014 3:00	0.80	0.43	0.52	X			SD
8/23/2014 6:00	2.20	1.36	1.46	X			SD
8/23/2014 7:00	2.00	1.40	1.60	X			MG
8/23/2014 8:00	1.80	1.80	2.00	X	0.2	0.2	MG
8/23/2014 9:00	1.20	1.80	2.00	0.60			MG
8/23/2014 10:00	1.20	2.00	2.00	1.00			MG
8/23/2014 11:00	1.20	1.80	1.80	1.40			MG
8/23/2014 12:00	1.20	1.80	1.80	1.60	0.2	0.2	MG
8/23/2014 13:00	1.20	1.60	1.60	1.80			MG
8/23/2014 14:00	1.20	1.20	1.20	2.00			MG
8/23/2014 15:00	1.00	1.00	1.20	1.20			BJR
8/23/2014 16:00	0.80	1.00	1.20	X			BJR
8/23/2014 17:00	1.40	1.20	1.20	X	0.1	0.0	BJR
8/23/2014 18:00	1.20	1.00	1.40	X			BJR
8/23/2014 19:00	1.20	1.60	1.60	X			BJR
8/23/2014 20:00	1.40	1.40	1.40	X			BJR
8/23/2014 21:00	1.60	1.60	1.20	X			BJR
8/23/2014 22:00				X			BJR
8/24/2014 0:00				X			
8/24/2014 3:00	1.34	1.41	1.38	X			SD
8/24/2014 6:00	1.53	1.45	1.34	X			SD
8/24/2014 7:00	1.00	1.00	1.20	X			MW
8/24/2014 8:00	1.20	1.20	1.40	X	0.2	0.2	MW
8/24/2014 9:00	1.00	1.20	1.20	3.00			MW
8/24/2014 10:00	0.80	1.00	1.20	2.60			MW
8/24/2014 11:00	1.00	1.20	1.20	2.60			MW
8/24/2014 12:00	1.20	1.20	1.40	2.20	2.0	2.0	MW
8/24/2014 13:00	1.00	1.20	1.20	2.00			MW
8/24/2014 14:00	0.80	1.00	1.20	1.80			MW
8/24/2014 15:00	1.07	0.77	0.96	1.23			LG
8/24/2014 16:00	0.82	0.55	0.46	1.26			LG
8/24/2014 17:00	1.97	0.58	0.55	1.27	0.2	0.2	LG
8/24/2014 18:00	0.82	0.62	1.02	X			LG
8/24/2014 19:00	0.76	1.46	1.27	X			LG
8/24/2014 20:00	1.16			X			LG
8/24/2014 21:00	2.06	1.63	1.31	X			LG
8/24/2014 22:00				X			LG
8/25/2014 0:00				X			
8/25/2014 3:00	0.79	1.73	1.50	X			SD
8/25/2014 6:00	0.90	1.95	1.91	X			SD
8/25/2014 7:00	1.20	2.00	1.80	X			MG
8/25/2014 8:00	1.40	1.80	1.80	X	0.2	0.2	MG
8/25/2014 9:00	1.00	1.60	1.60	0.40			MG
8/25/2014 10:00	1.00	1.60	1.60	1.00			MG
8/25/2014 11:00	1.00	1.40	1.40	2.00			MG
8/25/2014 12:00	1.20	1.40	1.40	4.60	0.2	0.2	MG
8/25/2014 13:00	1.20	1.60	1.60	4.00			MG
8/25/2014 14:00	1.20	1.60	1.60	5.00			MG
8/25/2014 15:00	0.94	0.94	1.08	2.60			LG
8/25/2014 16:00	0.53	0.66	0.86	1.61			LG
8/25/2014 17:00	0.31	1.59	1.51	X	0.3	0.2	LG
8/25/2014 18:00	0.66	1.29	1.10	X			LG
8/25/2014 19:00	1.71	1.45		X			LG

GLENWOOD HOT SPRINGS
 POOL MAINTENANCE DEPT.

OPERATOR'S DAILY LOG

August 2014

Date Time	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Kiddie Free Chlorine	Combined Chlorine M-Pool	Combined Chlorine T-Pool	Operator Initials
8/25/2014 20:00	1.54	1.45	1.59	X			LG
8/25/2014 21:00	1.17	1.46	1.20	X			LG
8/25/2014 22:00				X			LG
8/26/2014 0:00				X			
8/26/2014 3:00	0.76	1.50	1.38	X			SD
8/26/2014 6:00	1.11	1.83	1.55	X			SD
8/26/2014 7:00	1.00	2.00	2.20	X			MW
8/26/2014 8:00	1.00	1.60	1.80	X	0.2	0.2	MW
8/26/2014 9:00	1.20	1.20	1.40	X			MW
8/26/2014 10:00	1.20	1.20	1.20	2.00			MW
8/26/2014 11:00	1.20	1.00	1.20	1.80			MW
8/26/2014 12:00	1.00	1.00	1.20	1.60	0.2	0.2	MW
8/26/2014 13:00	1.40	1.00	1.00	2.00			MW
8/26/2014 14:00	1.40	1.60	1.60	2.40			MW
8/26/2014 15:00	0.92	1.91	1.90	1.06			LG
8/26/2014 16:00	0.88	1.94	2.03	0.52			LG
8/26/2014 17:00	0.74	1.75	2.16	0.25	0.2	0.4	LG
8/26/2014 18:00	0.64	1.27	1.32	X			LG
8/26/2014 19:00	0.60	1.29	1.24	X			LG
8/26/2014 20:00	0.47	0.79	0.55	X			LG
8/26/2014 21:00	0.56	0.25	0.53	X			LG
8/26/2014 22:00				X			LG
8/27/2014 0:00				X			BJR
8/27/2014 3:00	1.40	1.00	1.60	X			BJR
8/27/2014 6:00	1.40	1.80	1.40	X			BJR
8/27/2014 7:00	1.80	3.00	3.20	X			mw
8/27/2014 8:00	1.60	2.60	2.80	X	0.2	0.2	mw
8/27/2014 9:00	1.40	2.60	2.60	X			mw
8/27/2014 10:00	1.40	2.00	2.20	1.80			mw
8/27/2014 11:00	1.20	1.60	1.80	1.80			mw
8/27/2014 12:00	1.00	1.40	1.60	2.00	0.2	0.2	mw
8/27/2014 13:00	1.20	1.40	1.40	2.40			mw
8/27/2014 14:00	1.20	1.20	1.40	2.20			mw
8/27/2014 15:00	1.14	2.02	1.85	1.82			LG
8/27/2014 16:00	0.95	1.71	1.64	1.35			LG
8/27/2014 17:00	0.46	1.08	1.27	0.39	0.3	0.3	LG
8/27/2014 18:00	0.92	0.72	1.06	X			LG
8/27/2014 19:00	1.01	0.91	0.90	X			LG
8/27/2014 20:00	1.94	1.03	0.59	X			LG
8/27/2014 21:00	1.62	0.49	0.40	X			LG
8/27/2014 22:00				X			LG
8/28/2014 0:00				X			BJR
8/28/2014 3:00	1.00	1.40	1.20	X			BJR
8/28/2014 6:00	1.20	1.60	1.40	X			BJR
8/28/2014 7:00	1.40	2.00	2.00	X			MW
8/28/2014 8:00	1.40	1.60	1.80	X	0.2	0.2	MW
8/28/2014 9:00	1.20	1.60	1.60	X			MW
8/28/2014 10:00	1.00	1.40	1.60	1.40			MW
8/28/2014 11:00	1.00	1.20	1.20	1.60			MW
8/28/2014 12:00	0.80	1.20	1.40	1.60	0.2	0.2	MW
8/28/2014 13:00	1.00	1.40	1.60	1.40			MW
8/28/2014 14:00	1.00	1.00	1.20	1.40			
8/28/2014 15:00				CLSD			LG
8/28/2014 16:00	2.11	1.11	0.93	X			LG
8/28/2014 17:00	0.73	1.19	1.65	X	0.2	0.4	LG
8/28/2014 18:00	1.56	1.23	1.48	X			LG
8/28/2014 19:00	0.68	1.87	1.58	X			LG
8/28/2014 20:00	2.70	1.54	1.94	X			LG
8/28/2014 21:00	1.53	1.41	1.30	X			LG

GLENWOOD HOT SPRINGS
 POOL MAINTENANCE DEPT.

OPERATOR'S DAILY LOG

August 2014

Date Time	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Kiddie Free Chlorine	Combined Chlorine M-Pool	Combined Chlorine T-Pool	Operator Initials
8/28/2014 22:00				X			LG
8/29/2014 0:00				X			
8/29/2014 3:00				X			
8/29/2014 6:00	1.27	0.81	0.72	X			SD
8/29/2014 7:00	1.20	1.00	1.20	X			MW
8/29/2014 8:00	1.20	1.20	1.40	X	0.2	0.2	MW
8/29/2014 9:00	1.00	1.00	1.20	1.80			MW
8/29/2014 10:00	1.20	1.20	1.20	2.40			MW
8/29/2014 11:00	1.00	1.00	1.00	2.00			MW
8/29/2014 12:00	0.80	1.20	1.20	1.80	0.2	0.2	MW
8/29/2014 13:00	1.20	1.20	1.40	1.60			MW
8/29/2014 14:00	1.40	1.40	1.40	1.60			MW
8/29/2014 15:00	1.60	1.40	1.20	1.40			BJR
8/29/2014 16:00	1.20	1.40	1.40	X			BJR
8/29/2014 17:00	1.60	1.40	1.20	X	0.1	0.1	BJR
8/29/2014 18:00	1.20	1.20	1.40	X			BJR
8/29/2014 19:00	1.00	2.00	1.40	X			BJR
8/29/2014 20:00	1.60	1.60	1.80	X			BJR
8/29/2014 21:00	1.40	1.80	1.20	X			BJR
8/29/2014 22:00				X			BJR
8/30/2014 0:00				X			
8/30/2014 3:00	1.15	1.10	1.35	X			SD
8/30/2014 6:00	0.97	1.42	1.31	X			SD
8/30/2014 7:00	0.60	1.00	1.20	X			MW
8/30/2014 8:00	0.80	1.00	1.00	X	0.2	0.2	MW
8/30/2014 9:00	1.00	1.00	1.20	X			MW
8/30/2014 10:00	0.80	1.00	1.20	2.20			MW
8/30/2014 11:00	0.80	1.00	1.00	2.00			MW
8/30/2014 12:00	0.60	0.80	1.00	1.80	0.2	0.2	MW
8/30/2014 13:00	1.60	1.00	1.20	1.60			MW
8/30/2014 14:00	1.20	1.20	1.40	1.40			MW
8/30/2014 15:00	1.00	1.80	1.20	1.00			BJR
8/30/2014 16:00	1.20	1.00	1.40	1.20			BJR
8/30/2014 17:00	1.00	1.20	1.20	0.10	0.0	0.1	BJR
8/30/2014 18:00	1.00	1.00	1.20	X			BJR
8/30/2014 19:00	0.80	1.20	1.00	X			BJR
8/30/2014 20:00	1.20	0.80	0.80	X			BJR
8/30/2014 21:00	1.00	0.60	0.60	X			BJR
8/30/2014 22:00				X			BJR
8/31/2014 0:00				X			
8/31/2014 3:00	0.56	0.38	0.47	X			SD
8/31/2014 6:00	1.25	1.75	1.25	X			SD
8/31/2014 7:00	0.80	1.20	1.00	X			MW
8/31/2014 8:00	1.00	1.20	1.20	X	0.2	0.2	MW
8/31/2014 9:00	1.20	1.00	1.20	X			MW
8/31/2014 10:00	1.00	1.00	1.00	2.20			MW
8/31/2014 11:00	0.80	1.00	1.20	1.80			MW
8/31/2014 12:00	1.00	1.40	1.40	1.60	0.2	0.2	MW
8/31/2014 13:00	1.00	1.20	1.40	1.40			MW
8/31/2014 14:00	1.00	1.20	1.20	1.20			MW
8/31/2014 15:00	0.65	0.77	0.68	0.45			LG
8/31/2014 16:00	0.54	1.15	0.77	0.55			LG
8/31/2014 17:00	1.13	1.35	1.30	X	0.4	0.4	LG
8/31/2014 18:00	1.13	1.40	1.61	X			LG
8/31/2014 19:00	0.36		1.56	X			LG
8/31/2014 20:00	2.60	1.95	2.30	X			LG
8/31/2014 21:00	1.93	1.99	1.69	X			LG
8/31/2014 22:00							

GLENWOOD HOT SPRINGS

POOL MAINTENANCE DEPT.

OPERATOR'S DAILY LOG

September 2014

Time	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Kiddie Free Chlorine	Combined Chlorine T-Pool	Combined Chlorine M-Pool	Operator Initials
9/1/14 12:00 AM				X			
9/1/14 3:00 AM	2.20	1.45	1.53	X			SD
9/1/14 6:00 AM	0.85	1.75	1.29	X			SD
9/1/14 7:00 AM	1.20	0.80	1.00	X			MW
9/1/14 8:00 AM	1.00	1.00	1.00	X	0.2	0.2	MW
9/1/14 9:00 AM	0.80	1.00	1.20	X			MW
9/1/14 10:00 AM	0.80	1.00	1.00	1.40			MW
9/1/14 11:00 AM	1.00	1.00	1.20	1.20			MW
9/1/14 12:00 PM	1.20	1.20	1.40	1.20	0.2	0.2	MW
9/1/14 1:00 PM	1.00	1.20	1.20	1.40			MW
9/1/14 2:00 PM	0.91	0.75	0.75	1.09			LG
9/1/14 3:00 PM	0.82	1.22	1.17	1.33			LG
9/1/14 4:00 PM	0.53	1.10	1.15	0.74			LG
9/1/14 5:00 PM	1.24	1.42	1.34	0.84	0.3	0.2	LG
9/1/14 6:00 PM	0.77	1.27	1.67	X			LG
9/1/14 7:00 PM	0.88	1.32	1.39	X			LG
9/1/14 8:00 PM	1.44	1.58	1.35	X			LG
9/1/14 9:00 PM	1.28	1.09	1.14	X			LG
9/1/14 10:00 PM				X			LG
9/2/14 12:00 AM				X			
9/2/14 3:00 AM	0.69	0.69	0.55	X			SD
9/2/14 6:00 AM	1.10	1.17	1.12	X			SD
9/2/14 7:00 AM	1.00	1.00	1.00	X			MW
9/2/14 8:00 AM	1.00	1.00	1.20	X	0.2	0.2	MW
9/2/14 9:00 AM	1.20	0.80	1.00	X			MW
9/2/14 10:00 AM	1.20	1.20	1.20	X			MW
9/2/14 11:00 AM	1.00	1.60	1.80	X			MW
9/2/14 12:00 PM	1.20	1.60	1.60	X	0.0	0.2	MW
9/2/14 1:00 PM	1.20	1.40	1.60	X			MW
9/2/14 2:00 PM	1.20	1.20	1.40	X			MW
9/2/14 3:00 PM	1.48	0.99	0.95	X			LG
9/2/14 4:00 PM	1.53	0.72	1.08	X			LG
9/2/14 5:00 PM	1.63	1.60	1.46	X	0.1	0.3	LG
9/2/14 6:00 PM	1.99	1.78	1.79	X			LG
9/2/14 7:00 PM	1.80	1.80	1.78	X			LG
9/2/14 8:00 PM	1.91	1.74	1.82	X			LG
9/2/14 9:00 PM	1.96	1.16	1.17	X			LG
9/2/14 10:00 PM				X			LG
9/3/14 12:00 AM				X	BACKWASH		BJR
9/3/14 3:00 AM	0.80	1.00	0.80	X			BJR
9/3/14 6:00 AM	1.20	1.00	1.40	X			BJR
9/3/14 7:00 AM	1.00	2.20	2.40	X			MG
9/3/14 8:00 AM	1.00	2.20	2.20	X	0.2	0.2	MG
9/3/14 9:00 AM	1.00	2.00	2.20	X			MG
9/3/14 10:00 AM	1.00	2.00	2.20	X			MG
9/3/14 11:00 AM	1.20	1.40	1.40	X			MG
9/3/14 12:00 PM	1.20	1.20	1.40	X	0.2	0.2	MG
9/3/14 1:00 PM	1.20	1.20	1.20	X			MG
9/3/14 2:00 PM	1.20	1.20	1.20	X			MG
9/3/14 3:00 PM	0.64	0.95	0.87	X			LG
9/3/14 4:00 PM	1.80	0.94	1.14	X			LG
9/3/14 5:00 PM	0.78	1.50	1.50	X	0.3	0.1	LG
9/3/14 6:00 PM	2.13	1.43	1.79	X			LG
9/3/14 7:00 PM	2.80	1.47	1.72	X			LG
9/3/14 8:00 PM	1.66	1.77	1.79	X			LG
9/3/14 9:00 PM	2.00	1.42	1.48	X			LG

GLENWOOD HOT SPRINGS

POOL MAINTENANCE DEPT.

OPERATOR'S DAILY LOG

September 2014

Time	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Kiddie Free Chlorine	Combined Chlorine T-Pool	Combined Chlorine M-Pool	Operator Initials
9/3/14 10:00 PM				X			LG
9/4/14 12:00 PM				X			BJR
9/4/14 3:00 AM	1.00	0.80	1.00	X			BJR
9/4/14 6:00 AM	1.20	1.20	1.20	X			BJR
9/4/14 7:00 AM	1.00	1.80	2.00	X			MG
9/4/14 8:00 AM	1.00	2.40	2.20	X	0.2	0.2	MG
9/4/14 9:00 AM	1.00	1.80	1.80	X			MG
9/4/14 10:00 AM	1.00	1.80	1.80	X			MG
9/4/14 11:00 AM	1.20	1.60	1.60	X			MG
9/4/14 12:00 PM	1.20	1.60	1.80	X	0.2	0.2	MG
9/4/14 1:00 PM	1.20	1.60	1.60	X			MG
9/4/14 2:00 PM	1.40	1.40	1.40	X			MG
9/4/14 3:00 PM	0.72	1.52	1.84	X			LG
9/4/14 4:00 PM	1.82	1.83	1.77	XX			LG
9/4/14 5:00 PM	1.42	1.65	1.13	X	0.4	0.1	LG
9/4/14 6:00 PM	1.55	1.54	1.43	X			LG
9/4/14 7:00 PM	1.33	1.50	1.63	X			LG
9/4/14 8:00 PM	0.95	1.47	1.59	X			LG
9/4/14 9:00 PM	1.13	1.29	1.77	X			LG
9/4/14 10:00 PM				X	maint		LG
9/5/14 12:00 AM				X			
9/5/14 3:00 AM				X			
9/5/14 6:00 AM	1.41	0.42	0.32	X			SD
9/5/14 7:00 AM	0.80	1.20	1.40	X			MG
9/5/14 8:00 AM	0.80	1.60	1.60	X	0.2	0.2	MG
9/5/14 9:00 AM	1.00	1.40	1.40	X			MG
9/5/14 10:00 AM	1.00	1.40	1.40	X			MG
9/5/14 11:00 AM	1.00	1.40	1.40	X			MG
9/5/14 12:00 PM	1.00	1.40	1.40	X	0.2	0.1	MG
9/5/14 1:00 PM	1.00	1.00	1.00	X			MG
9/5/14 2:00 PM	1.00	1.00	1.00	X			MG
9/5/14 3:00 PM	0.80	1.40	1.40	X			BJR
9/5/14 4:00 PM	1.00	1.00	1.40	X			BJR
9/5/14 5:00 PM	1.40	1.40	1.20	X	0.1	0.1	BJR
9/5/14 6:00 PM	1.20	1.60	1.40	X			BJR
9/5/14 7:00 PM	1.40	2.00	1.40	X			BJR
9/5/14 8:00 PM	2.00	1.80	1.40	X			BJR
9/5/14 9:00 PM	1.20	2.00	1.20	X			BJR
9/5/14 10:00 PM				X			BJR
9/6/14 12:00 AM							
9/6/14 3:00 AM	1.32	1.88	1.48				SD
9/6/14 6:00 AM	0.91	1.42	1.25				SD
9/6/14 7:00 AM	1.00	1.20	1.40		0.20	0.20	MW
9/6/14 8:00 AM	1.20	1.40	1.40				MW
9/6/14 9:00 AM	1.00	1.40	1.60				MW
9/6/14 10:00 AM	1.40	1.20	1.40				MW
9/6/14 11:00 AM	1.60	1.20	1.40				MW
9/6/14 12:00 PM	1.40	1.00	1.20		0.20	0.20	MW
9/6/14 1:00 PM	1.00	0.80	1.00				MW
9/6/14 2:00 PM	1.40	1.00	1.00				MW
9/6/14 3:00 PM	1.00	1.00	0.80				BJR
9/6/14 4:00 PM	1.00	0.80	1.20				BJR
9/6/14 5:00 PM	1.20	1.80	1.40		0.00	1.00	BJR
9/6/14 6:00 PM	1.40	1.20	1.20				BJR
9/6/14 7:00 PM	1.40	1.60	1.40				BJR
9/6/14 8:00 PM	1.00	1.20	1.20				BJR

GLENWOOD HOT SPRINGS

POOL MAINTENANCE DEPT.

OPERATOR'S DAILY LOG

September 2014

Time	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Kiddie Free Chlorine	Combined Chlorine T-Pool	Combined Chlorine M-Pool	Operator Initials
9/6/14 9:00 PM	1.00	1.20	1.20				BJR
9/6/14 10:00 PM							BJR
9/7/14 12:00 AM							
9/7/14 3:00 AM	1.10	0.98	1.26				SD
9/7/14 6:00 AM	0.85	1.54	1.70				SD
9/7/14 7:00 AM	1.00	2.40	2.40		0.00	0.00	MW
9/7/14 8:00 AM	1.20	2.00	2.20				MW
9/7/14 9:00 AM	1.20	1.80	2.00				MW
9/7/14 10:00 AM	1.00	1.40	1.60				MW
9/7/14 11:00 AM	0.80	1.20	1.40				MW
9/7/14 12:00 PM	0.60	1.00	1.20		0.20	0.20	MW
9/7/14 1:00 PM	0.80	1.20	1.20				MW
9/7/14 2:00 PM	1.00	1.20	1.40				MW
9/7/14 3:00 PM	1.92	0.91	1.27				LG
9/7/14 4:00 PM	2.30	1.40	0.87				LG
9/7/14 5:00 PM	1.87	0.87	1.46		0.10	0.33	LG
9/7/14 6:00 PM	1.43	0.99	1.04				LG
9/7/14 7:00 PM	1.54	0.97	0.92				LG
9/7/14 8:00 PM	1.43	1.08	0.88				LG
9/7/14 9:00 PM	2.13	1.06	1.07				LG
9/7/14 10:00 PM							LG
9/8/14 12:00 AM							
9/8/14 3:00 AM	1.13	1.73	1.68				SD
9/8/14 6:00 AM	0.61	1.62	1.71				SD
9/8/14 7:00 AM	0.80	1.60	1.60		0.20	0.20	MW
9/8/14 8:00 AM	1.00	1.40	1.60				MW
9/8/14 9:00 AM	1.20	1.20	1.40				MW
9/8/14 10:00 AM	1.20	1.20	1.40				MW
9/8/14 11:00 AM	1.20	1.20	1.20				MW
9/8/14 12:00 PM	1.20	1.00	1.20		0.20	0.20	MW
9/8/14 1:00 PM	1.20	1.00	1.00				MW
9/8/14 2:00 PM	1.40	1.20	1.20				MW
9/8/14 3:00 PM	1.88	2.50	2.30				LG
9/8/14 4:00 PM	2.03	2.10	2.30				LG
9/8/14 5:00 PM	1.96	1.42	0.96		0.13	0.22	LG
9/8/14 6:00 PM	0.95	1.02	1.36				LG
9/8/14 7:00 PM	0.67	0.93	0.94				LG
9/8/14 8:00 PM	0.80	0.85	0.81				LG
9/8/14 9:00 PM	0.39	0.59	0.56				LG
9/8/14 10:00 PM							LG
9/9/14 12:00 AM							
9/9/14 3:00 AM	0.88	0.85	0.75				SD
9/9/14 6:00 AM	0.84	1.18	1.23				SD
9/9/14 7:00 AM	1.20	1.00	1.20		0.20	0.20	MG
9/9/14 8:00 AM	1.20	1.40	1.60				MG
9/9/14 9:00 AM	1.20	1.60	1.80				MG
9/9/14 10:00 AM	1.00	1.60	1.80				MG
9/9/14 11:00 AM	1.00	1.60	1.80				MG
9/9/14 12:00 PM	1.00	1.40	1.40		0.20	0.20	MG
9/9/14 1:00 PM	1.00	1.40	1.40				MG
9/9/14 2:00 PM	1.00	1.40	1.40				MG
9/9/14 3:00 PM	0.25	0.99	1.12				LG
9/9/14 4:00 PM	0.39						LG
9/9/14 5:00 PM	1.38	0.80	0.65		0.35	0.07	LG
9/9/14 6:00 PM	1.25	0.51	0.80				LG
9/9/14 7:00 PM	0.98	0.84	0.77				LG

GLENWOOD HOT SPRINGS

POOL MAINTENANCE DEPT.

OPERATOR'S DAILY LOG

September 2014

Time	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Kiddie Free Chlorine	Combined Chlorine T-Pool	Combined Chlorine M-Pool	Operator Initials
9/9/14 8:00 PM	1.32	0.91	0.83				LG
9/9/14 9:00 PM	1.88						LG
9/9/14 10:00 PM							LG
9/11/14 12:00 AM							BJR
9/11/14 3:00 AM	0.40	1.00	0.80				BJR
9/11/14 6:00 AM	0.60	1.00	1.00				BJR
9/11/14 7:00 AM	0.40	1.40	1.40		0.00	0.01	MG
9/11/14 8:00 AM	0.60	1.60	1.60				MG
9/11/14 9:00 AM	0.60	1.60	1.60				MG
9/11/14 10:00 AM	0.80	1.60	1.60				MG
9/11/14 11:00 AM	0.80	1.40	1.40				MG
9/11/14 12:00 PM	1.00	1.20	1.00		0.20	0.20	MG
9/11/14 1:00 PM	1.00	1.00	1.10				MG
9/11/14 2:00 PM	1.00	1.00	1.00				MG
9/11/14 3:00 PM	0.80	1.60	2.00				MW
9/11/14 4:00 PM	1.60	1.60	1.80				MW
9/11/14 5:00 PM	1.20	1.60	1.60		0.20	0.20	MW
9/11/14 6:00 PM	1.00	1.60	1.60				MW
9/11/14 7:00 PM	0.80	1.60	2.00				MW
9/11/14 8:00 PM	1.00	1.40	1.60				
9/11/14 9:00 PM	1.00	1.20	1.40				
9/11/14 10:00 PM	1.20	1.20	1.20				
9/12/14 12:00 AM							
9/12/14 3:00 AM	1.80	1.43	1.35				SD
9/12/14 6:00 AM	1.10	1.46	1.24				SD
9/12/14 7:00 AM	0.80	1.60	1.80		0.20	0.20	MG
9/12/14 8:00 AM	0.80	2.00	2.00				MG
9/12/14 9:00 AM	0.80	2.00	2.00				MG
9/12/14 10:00 AM	1.00	1.80	1.80				MG
9/12/14 11:00 AM	0.80	1.60	1.60				MG
9/12/14 12:00 PM	1.00	1.60	1.60		0.20	0.20	MG
9/12/14 1:00 PM	1.00	1.20	1.20				MG
9/12/14 2:00 PM	1.00	1.00	1.00				MG
9/12/14 3:00 PM	1.00	0.80	1.20				BJR
9/12/14 4:00 PM	0.80	1.00	1.20				BJR
9/12/14 5:00 PM	1.00	1.60	1.60		0.00	0.10	BJR
9/12/14 6:00 PM	1.00	1.60	1.40				BJR
9/12/14 7:00 PM	1.20	2.80	2.40				BJR
9/12/14 8:00 PM	1.40	2.20	1.60				BJR
9/12/14 9:00 PM	1.40	2.00	1.60				BJR
9/12/14 10:00 PM							BJR
9/13/14 12:00 AM							
9/13/14 3:00 AM	1.88	1.28	0.85				SD
9/13/14 6:00 AM	1.20	1.41	1.15				SD
9/13/14 7:00 AM	1.00	2.00	2.00		0.20	0.20	MG
9/13/14 8:00 AM	1.00	2.00	2.00				MG
9/13/14 9:00 AM	1.00	1.80	1.80				MG
9/13/14 10:00 AM	1.20	1.60	1.60				MG
9/13/14 11:00 AM	1.20	1.60	1.60				MG
9/13/14 12:00 PM	1.00	1.40	1.40		0.10	0.20	MG
9/13/14 1:00 PM	1.00	1.20	1.20				MG
9/13/14 2:00 PM	1.00	1.00	1.00				MG
9/13/14 3:00 PM	0.60	1.00	1.20				BJR
9/13/14 4:00 PM	1.20	1.20	1.00				BJR
9/13/14 5:00 PM	1.00	1.20	1.60		0.10	0.00	BJR
9/13/14 6:00 PM	1.40	1.20	1.20				BJR

GLENWOOD HOT SPRINGS

POOL MAINTENANCE DEPT.

OPERATOR'S DAILY LOG

September 2014

Time	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Kiddie Free Chlorine	Combined Chlorine T-Pool	Combined Chlorine M-Pool	Operator Initials
9/13/14 7:00 PM	1.20	1.80	1.20				BJR
9/13/14 8:00 PM	1.00	1.60	1.40				BJR
9/13/14 9:00 PM	1.00	1.40	1.00				BJR
9/13/14 10:00 PM							BJR
9/14/14 12:00 AM							
9/14/14 3:00 AM	0.85	1.35	1.45				SD
9/14/14 6:00 AM	0.92	1.82	1.80				SD
9/14/14 7:00 AM	0.60	1.60	1.60		0.20	0.20	MW
9/14/14 8:00 AM	0.60	1.60	1.40				MW
9/14/14 9:00 AM	1.00	1.40	1.80				MW
9/14/14 10:00 AM	1.00	1.20	1.40				MW
9/14/14 11:00 AM	0.80	1.20	1.40				MW
9/14/14 12:00 PM	0.80	1.00	1.20		0.20	0.20	MW
9/14/14 1:00 PM	1.00	1.20	1.20				MW
9/14/14 2:00 PM	1.00						MW
9/14/14 3:00 PM	1.82	1.48	1.40				LG
9/14/14 4:00 PM	0.89	1.30	1.40				LG
9/14/14 5:00 PM	1.05	1.33	1.33		0.18	0.10	LG
9/14/14 6:00 PM	2.16	1.18	1.45				LG
9/14/14 7:00 PM	1.56	0.97	1.70				LG
9/14/14 8:00 PM	1.63	1.25	1.17				LG
9/14/14 9:00 PM	0.94	1.21	0.95				LG
9/14/14 10:00 PM							LG
9/15/14 12:00 AM							
9/15/14 3:00 AM	2.17	0.89	1.17				SD
9/15/14 6:00 AM	1.50	1.37	1.48				SD
9/15/14 7:00 AM	1.20	1.20	1.20		0.20	0.20	MW
9/15/14 8:00 AM	1.00	1.20	1.20				MW
9/15/14 9:00 AM	1.20	1.40	1.40				MW
9/15/14 10:00 AM	1.00	1.40	1.60				MW
9/15/14 11:00 AM	1.60	1.20	1.40				MW
9/15/14 12:00 PM	1.40	1.00	1.20		0.20	0.20	MW
9/15/14 1:00 PM	1.20	1.00	1.20				MW
9/15/14 2:00 PM	1.00	1.20	1.40				MW
9/15/14 3:00 PM	2.20	1.94	2.30				LG
9/15/14 4:00 PM	1.11	1.56	1.51				LG
9/15/14 5:00 PM	1.42	1.89	1.62		0.25	0.10	LG
9/15/14 6:00 PM	1.13	1.87	1.80				LG
9/15/14 7:00 PM	0.69	1.53	1.93				LG
9/15/14 8:00 PM	0.67	1.51	1.36				LG
9/15/14 9:00 PM	0.33	1.26	1.10				LG
9/15/14 10:00 PM							LG
9/16/14 12:00 AM							
9/16/14 3:00 AM	0.60	1.22	1.43				sd
9/16/14 6:00 AM	1.45	1.58	1.48				SD
9/16/14 7:00 AM	1.40	1.40	1.40		0.20	0.20	mw
9/16/14 8:00 AM	1.40	1.40	1.60				mw
9/16/14 9:00 AM	1.60	1.40	1.60				mw
9/16/14 10:00 AM	1.40	1.60	1.80				mw
9/16/14 11:00 AM	1.20	1.40	1.40				mw
9/16/14 12:00 PM	1.00	1.20	1.20		0.20	0.20	mw
9/16/14 1:00 PM	1.00	1.00	1.20				mw
9/16/14 2:00 PM	1.40	1.00	1.20				mw
9/16/14 3:00 PM	0.64	1.13	1.22				LG
9/16/14 4:00 PM	1.11	0.95	1.09				LG
9/16/14 5:00 PM	0.66	0.69	1.03		0.20	0.40	LG

GLENWOOD HOT SPRINGS

POOL MAINTENANCE DEPT.

OPERATOR'S DAILY LOG

September 2014

Time	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Kiddie Free Chlorine	Combined Chlorine T-Pool	Combined Chlorine M-Pool	Operator Initials
9/16/14 6:00 PM	1.11	0.82	0.76				LG
9/16/14 7:00 PM	0.53	0.60	0.69				LG
9/16/14 8:00 PM	1.00	0.61	0.59				LG
9/16/14 9:00 PM	1.13	0.58	0.41				LG
9/16/14 10:00 PM							LG
9/17/14 12:00 AM							
9/17/14 3:00 AM	0.60	1.22	1.43				sd
9/17/14 6:00 AM	1.00	1.45	1.48				SD
9/17/14 7:00 AM	1.10	1.30	1.40		0.20	0.20	mw
9/17/14 8:00 AM	1.10	1.40	1.60				mw
9/17/14 9:00 AM	1.60	1.40	1.60				mw
9/17/14 10:00 AM	1.20	1.60	1.80				mw
9/17/14 11:00 AM	0.88	0.80	1.40				mw
9/17/14 12:00 PM	1.00	1.20	1.20		0.20	0.20	mw
9/17/14 1:00 PM	1.00	1.00	1.20				mw
9/17/14 2:00 PM	1.00	1.00	1.20				mw
9/17/14 3:00 PM	0.64	1.13	1.22				LG
9/17/14 4:00 PM	1.11	0.95	1.09				LG
9/17/14 5:00 PM	0.66	0.69	1.03		0.20	0.40	LG
9/17/14 6:00 PM	1.11	0.82	0.76				LG
9/17/14 7:00 PM	0.53	0.60	0.69				LG
9/17/14 8:00 PM	1.00	0.61	0.59				LG
9/17/14 9:00 PM	1.13	0.58	0.41				LG
9/17/14 10:00 PM							LG
9/18/14 12:00 AM							MG
9/18/14 3:00 AM		0.80	0.80				MG
9/18/14 6:00 AM	0.60	1.40	1.40				MG
9/18/14 7:00 AM	0.60	1.60	1.60		0.00	0.10	MG
9/18/14 8:00 AM	0.80	1.40	1.60				MG
9/18/14 9:00 AM	0.47	1.20	1.00				BA
9/18/14 10:00 AM	0.66	0.66	0.75				ba
9/18/14 11:00 AM	0.34	0.50	0.62				ba
9/18/14 12:00 PM	0.88	0.96	1.00		0.00	0.00	ba
9/18/14 1:00 PM	0.44	0.65	0.74				ba
9/18/14 2:00 PM	1.01	1.42					LG
9/18/14 3:00 PM	1.26	0.91	1.17				LG
9/18/14 4:00 PM	0.82	1.02	0.96				LG
9/18/14 5:00 PM	1.03	0.79	1.00		0.40	0.40	LG
9/18/14 6:00 PM	1.93	1.66	1.21				LG
9/18/14 7:00 PM	1.51	1.17	1.48				LG
9/18/14 8:00 PM	1.33	1.49	1.67				LG
9/18/14 9:00 PM	1.38	1.61	1.39				LG
9/18/14 10:00 PM							LG
9/19/14 12:00 AM							
9/19/14 3:00 AM	1.74	0.47	0.76				
9/19/14 6:00 AM	1.48	0.96	0.96				
9/19/14 8:00 AM	1.00	1.20	1.20		0	0.1	MG
9/19/14 9:00 AM	1.00	1.40	1.40				
9/19/14 10:00 AM	1.00	1.40	1.40				MG
9/19/14 11:00 AM	1.00	1.40	1.40				
9/19/14 12:00 PM	0.80	1.40	1.40				MG
9/19/14 1:00 PM	1.00	1.20	1.20		0	0	
9/19/14 2:00 PM	1.00	1.20	1.00				MG
9/19/14 3:00 PM	1.00	1.20	1.20				
9/19/14 4:00 PM	1.00	1.20	1.20				MW
9/19/14 5:00 PM	1.20	1.40	1.60				

GLENWOOD HOT SPRINGS

POOL MAINTENANCE DEPT.

OPERATOR'S DAILY LOG

September 2014

Time	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Kiddie Free Chlorine	Combined Chlorine T-Pool	Combined Chlorine M-Pool	Operator Initials
9/19/14 6:00 PM	1.20	1.60	1.60		0.2	0.0	MW
9/19/14 7:00 PM	1.40	1.60	1.80				
9/19/14 8:00 PM	1.60	1.60	2.00				
9/19/14 9:00 PM							
9/19/14 10:00 PM	1.40	1.40	1.40				
9/20/14 12:00 AM					BW		
9/20/14 3:00 AM	0.87						
9/20/14 6:00 AM	1.09	1.40	1.27				
9/20/14 8:00 AM	2.20	1.80	1.80		0.2	0.1	MG
9/20/14 9:00 AM	2.00	1.60	1.80				
9/20/14 10:00 AM	2.00	1.40	1.60				MG
9/20/14 11:00 AM	2.00	1.20	1.20				
9/20/14 12:00 PM	2.00	1.20	1.20				MG
9/20/14 1:00 PM	1.20	1.20	1.20		0.2	0.2	
9/20/14 2:00 PM	1.00	1.20	1.20				MG
9/20/14 3:00 PM	1.20	1.00	1.20				
9/20/14 4:00 PM	1.60	1.20	1.20				MW
9/20/14 5:00 PM	1.60	1.40	1.40				
9/20/14 6:00 PM	1.40	1.40	1.60		0.2	0.2	MW
9/20/14 7:00 PM	1.40	1.60	1.60				
9/20/14 8:00 PM	1.20	1.40	1.60				MW
9/20/14 9:00 PM	1.00	1.20	1.40				
9/20/14 10:00 PM	0.80	1.00	1.20				
9/21/14 12:00 AM							
9/21/14 3:00 AM	0.73	0.78	0.88				
9/21/14 6:00 AM	1.64	1.38	1.58				
9/21/14 8:00 AM	1.00	1.20	1.20		0.2	0.2	
9/21/14 9:00 AM	1.00	0.80	1.00				
9/21/14 10:00 AM	0.80	0.80	0.80				MG
9/21/14 11:00 AM	1.20	1.00	1.20				
9/21/14 12:00 PM	1.20	1.40	1.40				MW
9/21/14 1:00 PM	1.20	1.40	1.60		0.0	0.2	
9/21/14 2:00 PM	1.00	1.40	1.40				MW
9/21/14 3:00 PM	0.56	1.17					
9/21/14 4:00 PM	2.60	1.03	0.78				LG
9/21/14 5:00 PM	1.21	1.04	1.10				
9/21/14 6:00 PM	2.80	1.00	1.09		0.05	0.44	LG
9/21/14 7:00 PM	1.80	1.37	1.35				
9/21/14 8:00 PM	1.14	1.32	1.41				LG
9/21/14 9:00 PM	1.53	1.33	1.10				
9/21/14 10:00 PM							
9/22/14 12:00 AM							
9/22/14 3:00 AM	1.13	2.20	1.36				
9/22/14 6:00 AM	1.54	1.42	0.98				
9/22/14 8:00 AM	1.40	1.80	2.00		0.0	0.0	
9/22/14 9:00 AM	1.40	1.60	1.80				
9/22/14 10:00 AM	2.00	1.40	1.40				MW
9/22/14 11:00 AM	1.60	1.40	1.40				
9/22/14 12:00 PM	1.40	1.40	1.40				MW
9/22/14 1:00 PM	1.00	1.20	1.40		0.2	0.2	
9/22/14 2:00 PM	1.20	1.20	1.20				MW
9/22/14 3:00 PM	2.60	1.14	0.93				
9/22/14 4:00 PM	1.63	1.08	0.99				LG
9/22/14 5:00 PM	1.28	0.86	1.23				
9/22/14 6:00 PM	1.43	1.28	1.17		0.1	0.24	LG

GLENWOOD HOT SPRINGS

POOL MAINTENANCE DEPT.

OPERATOR'S DAILY LOG

September 2014

Time	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Kiddie Free Chlorine	Combined Chlorine T-Pool	Combined Chlorine M-Pool	Operator Initials
9/22/14 7:00 PM	2.15	1.34	1.27				
9/22/14 8:00 PM	0.62	1.26	1.43				LG
9/22/14 9:00 PM	1.29	1.39	1.46				
9/22/14 10:00 PM							
9/23/14 12:00 AM							
9/23/14 3:00 AM	2.20	1.23	1.39				
9/23/14 6:00 AM	2.20	1.37					
9/23/14 8:00 AM	1.80	1.40	1.60		0.2	0.2	MW
9/23/14 9:00 AM	1.60	1.60	1.80				
9/23/14 10:00 AM	1.40	1.20	1.40				MW
9/23/14 11:00 AM	1.40	1.00	1.20				
9/23/14 12:00 PM	1.40	1.00	1.20				MW
9/23/14 1:00 PM	1.20	1.00	1.00		0.2	0.2	
9/23/14 2:00 PM	1.20	1.20	1.40				MW
9/23/14 3:00 PM	2.30	1.43	1.51				
9/23/14 4:00 PM	1.27	0.63	1.01				LG
9/23/14 5:00 PM	2.14	1.14	1.21				
9/23/14 6:00 PM	1.34	1.04	0.98		0.07	0.28	LG
9/23/14 7:00 PM	1.19	0.81	0.87				
9/23/14 8:00 PM	1.38	0.75	0.77				LG
9/23/14 9:00 PM	1.41	0.36	0.49				
9/23/14 10:00 PM							
9/24/14 12:00 AM							
9/24/14 3:00 AM	1.20	1.20	1.45				
9/24/14 6:00 AM	1.50	1.02	1.10				
9/24/14 8:00 AM	1.80	1.40	1.60		0.2	0.2	MW
9/24/14 9:00 AM	1.60	1.60	1.80				
9/24/14 10:00 AM	1.40	1.20	1.40				MW
9/24/14 11:00 AM	1.40	1.00	1.20				
9/24/14 12:00 PM	1.40	1.00	1.20				MW
9/24/14 1:00 PM	1.20	1.00	1.00		0.2	0.2	
9/24/14 2:00 PM	1.20	1.20	1.40				MW
9/24/14 3:00 PM	1.20	1.43	1.51				
9/24/14 4:00 PM	1.27	0.63	1.01				LG
9/24/14 5:00 PM	1.30	1.14	1.21				
9/24/14 6:00 PM	1.34	1.04	0.98		0.07	0.28	LG
9/24/14 7:00 PM	1.19	0.81	0.87				
9/24/14 8:00 PM	1.38	0.75	0.77				LG
9/24/14 9:00 PM	1.41	0.36	0.49				
9/24/14 10:00 PM							
9/25/14 12:00 AM				X			
9/25/14 3:00 AM	1.00	0.68	0.41	X			SD
9/25/14 6:00 AM	1.20	1.16	1.13	X			SD
9/25/14 7:00 AM	1.20	1.40	1.20	X			MW
9/25/14 8:00 AM	1.40	1.60	1.60	X	0.0	.0.0	MW
9/25/14 9:00 AM	1.40	1.80	2.20	X			MW
9/25/14 10:00 AM	1.20	2.00	2.20	X			MW
9/25/14 11:00 AM	1.20	1.60	1.80	X			MW
9/25/14 12:00 PM	1.20	1.20	1.40	X	0.2	0.2	MW
9/25/14 1:00 PM	1.20	1.20	1.20	X			MW
9/25/14 2:00 PM	1.00	1.20	1.40	XX			MW
9/25/14 3:00 PM	0.80	1.20	1.00	X			BJR
9/25/14 4:00 PM	1.20	1.20	1.20	X			BJR
9/25/14 5:00 PM	1.00	1.40	1.20	X	0.1	0.1	BJR
9/25/14 6:00 PM	1.00	1.20	1.40	X			BJR

GLENWOOD HOT SPRINGS

POOL MAINTENANCE DEPT.

OPERATOR'S DAILY LOG

September 2014

Time	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Kiddie Free Chlorine	Combined Chlorine T-Pool	Combined Chlorine M-Pool	Operator Initials
9/25/14 7:00 PM	1.20	1.80	1.20	X			BJR
9/25/14 8:00 PM	1.00	1.60	1.20	X			BJR
9/25/14 9:00 PM	1.00	1.40	1.00	X			BJR
9/25/14 10:00 PM				X			BJR
9/26/14 12:00 AM				X			
9/26/14 3:00 AM				X			
9/26/14 6:00 AM	1.62	1.00	1.27	X			SD
9/26/14 7:00 AM	2.20	1.00	1.40	X			MW
9/26/14 8:00 AM	1.60	1.00	1.40	X	0.2	0.2	MW
9/26/14 9:00 AM	1.20	1.00	1.20	X			MW
9/26/14 10:00 AM	1.00	1.00	1.20	X	X		MW
9/26/14 11:00 AM	1.00	1.20	1.20	X			MW
9/26/14 12:00 PM	1.00	1.20	1.20	X	0.2	0.2	MW
9/26/14 1:00 PM	1.20	1.20	1.40	X			MW
9/26/14 2:00 PM	1.20	1.20	1.20	X			MW
9/26/14 3:00 PM	1.56	1.04	1.03	X			LG
9/26/14 4:00 PM	2.07	0.97	0.99	X			LG
9/26/14 5:00 PM	1.46	0.70	0.74	X	0.3	0.3	LG
9/26/14 6:00 PM	0.98	1.21	0.66	X			LG
9/26/14 7:00 PM	1.51	0.94	0.75	X			LG
9/26/14 8:00 PM	0.47	0.71	0.57	X			LG
9/26/14 9:00 PM	1.13	0.53	0.32	X			LG
9/26/14 10:00 PM				X			LG
9/27/14 12:00 AM				X			
9/27/14 3:00 AM	1.45	0.68	0.41	X			SD
9/27/14 6:00 AM	1.34	1.16	1.13	X			SD
9/27/14 7:00 AM	1.20	1.40	1.20	X			MW
9/27/14 8:00 AM	1.40	1.60	1.60	X	0.0	.0.0	MW
9/27/14 9:00 AM	1.40	1.80	2.20	X			MW
9/27/14 10:00 AM	1.20	2.00	2.20	X			MW
9/27/14 11:00 AM	1.20	1.60	1.80	X			MW
9/27/14 12:00 PM	1.20	1.20	1.40	X	0.2	0.2	MW
9/27/14 1:00 PM	1.20	1.20	1.20	X			MW
9/27/14 2:00 PM	1.00	1.20	1.40	XX			MW
9/27/14 3:00 PM	0.80	1.20	1.00	X			BJR
9/27/14 4:00 PM	1.20	1.20	1.20	X			BJR
9/27/14 5:00 PM	1.00	1.40	1.20	X	0.1	0.1	BJR
9/27/14 6:00 PM	1.00	1.20	1.40	X			BJR
9/27/14 7:00 PM	1.20	1.80	1.20	X			BJR
9/27/14 8:00 PM	1.00	1.60	1.20	X			BJR
9/27/14 9:00 PM	1.00	1.40	1.00	X			BJR
9/27/14 10:00 PM				X			BJR
9/28/14 12:00 AM							
9/28/14 3:00 AM	2.20	1.27	0.78				SD
9/28/14 6:00 AM	0.87	1.10	1.42				SD
9/28/14 7:00 AM	2.60	2.00	2.40		0.20	0.20	mw
9/28/14 8:00 AM	2.20	2.00	2.00				mw
9/28/14 9:00 AM	2.00	1.40	1.80				mw
9/28/14 10:00 AM	1.40	1.20	1.60				mw
9/28/14 11:00 AM	1.40	1.40	1.60				mw
9/28/14 12:00 PM	1.40	1.40	1.60		0.20	0.20	mw
9/28/14 1:00 PM	1.20	1.40	1.60				mw
9/28/14 2:00 PM	0.80	1.20	1.60				mw
9/28/14 3:00 PM	0.60	1.00	1.00				BJR
9/28/14 4:00 PM	1.00	1.20	1.20				BJR
9/28/14 5:00 PM	1.00	1.00	1.20		0.10	0.10	BJR

GLENWOOD HOT SPRINGS

POOL MAINTENANCE DEPT.

OPERATOR'S DAILY LOG

September 2014

Time	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Kiddie Free Chlorine	Combined Chlorine T-Pool	Combined Chlorine M-Pool	Operator Initials
9/28/14 6:00 PM	1.40	1.40	1.40				BJR
9/28/14 7:00 PM	1.60	1.40	1.40				BJR
9/28/14 8:00 PM	1.20	1.40	1.20				BJR
9/28/14 9:00 PM	3.00	1.60	1.20				BJR
9/28/14 10:00 PM							BJR
9/29/14 12:00 AM							
9/29/14 3:00 AM	1.09	1.33	1.26				SD
9/29/14 6:00 AM	1.89	1.98	1.54				SD
9/29/14 7:00 AM	1.60	1.40	1.40			0.20	mw
9/29/14 8:00 AM	1.60	1.60	2.00				mw
9/29/14 9:00 AM	1.40	1.60	1.80				mw
9/29/14 10:00 AM	1.20	1.60	1.80				mw
9/29/14 11:00 AM	1.00	1.40	1.40				mw
9/29/14 12:00 PM	1.00	1.40	1.40		0.20	0.20	mw
9/29/14 1:00 PM	1.20	1.20	1.20				mw
9/29/14 2:00 PM	1.20	1.20	1.40				mw
9/29/14 3:00 PM	1.30	1.88	1.59				LG
9/29/14 4:00 PM	1.20	1.27	1.15				LG
9/29/14 5:00 PM	0.96	1.90	1.89		0.25	0.10	LG
9/29/14 6:00 PM	0.46	1.63	1.25				LG
9/29/14 7:00 PM	2.30	1.48	0.93				LG
9/29/14 8:00 PM	1.71	1.28	1.29				LG
9/29/14 9:00 PM	2.70	1.44					
9/29/14 10:00 PM							
9/30/14 12:00 AM							
9/30/14 3:00 AM	1.59	0.87	0.66				SD
9/30/14 6:00 AM	1.71	0.85	0.58				SD
9/30/14 7:00 AM	1.60	1.20	1.40		0.20	0.10	MG
9/30/14 8:00 AM	1.40	1.60	1.60				MG
9/30/14 9:00 AM	1.40	1.80	1.80				MG
9/30/14 10:00 AM	1.20	1.80	1.80				MG
9/30/14 11:00 AM	1.20	1.40	1.40				MG
9/30/14 12:00 PM	1.20	1.20	1.20		0.10	0.00	MG
9/30/14 1:00 PM	1.20	1.20	1.20				MG
9/30/14 2:00 PM	1.20	1.20	1.20				MG
9/30/14 3:00 PM	1.18	1.23	1.31				LG
9/30/14 4:00 PM	1.38	1.24	1.02				LG
9/30/14 5:00 PM	1.00	1.14	0.98		0.21	0.39	LG
9/30/14 6:00 PM	1.48	1.18	1.17				LG
9/30/14 7:00 PM	1.66	1.04	1.05				LG
9/30/14 8:00 PM	1.39	0.75	0.85				LG
9/30/14 9:00 PM	0.63	0.84	0.27				LG
9/30/14 10:00 PM							LG

GLENWOOD HOT SPRINGS
POOL MAINTENANCE DEPT.
 Oct-14

Time & Date	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Combined Chlorine T Pool	Combined Chlorine M-Pool	Operator Initials
10/1/14 12:00 AM	0.80					BJR
10/1/14 3:00 AM	1.00	0.60	0.60			BJR
10/1/14 6:00 AM	1.20	1.20	1.00			BJR
10/1/14 7:00 AM	1.00	1.40	1.40	0.00	0.10	MG
10/1/14 8:00 AM	1.00	1.60	1.60			MG
10/1/14 9:00 AM	1.00	1.60	1.60			MG
10/1/14 10:00 AM	1.40	1.40	1.40			MG
10/1/14 11:00 AM	1.40	1.40	1.40			MG
10/1/14 12:00 PM	1.40	1.40	1.20	0.00	0.10	MG
10/1/14 1:00 PM	1.40	1.20	1.20			MG
10/1/14 2:00 PM	1.20	1.00	1.20			MG
10/1/14 3:00 PM	0.90	0.37	0.71			LG
10/1/14 4:00 PM	1.09	0.58	0.31			LG
10/1/14 5:00 PM	0.98	0.89	0.99	0.10	0.13	LG
10/1/14 6:00 PM	1.01	1.18	1.00			LG
10/1/14 7:00 PM	0.49	1.34	1.25			LG
10/1/14 8:00 PM	1.01	1.42	1.38			LG
10/1/14 9:00 PM	1.01					LG
10/1/14 10:00 PM						LG
10/2/14 12:00 AM	1.20	1.00	0.80			BJR
10/2/14 3:00 AM	1.20	1.40	1.00			BJR
10/2/14 6:00 AM	1.20	1.20	1.20			BJR
10/2/14 7:00 AM	1.20	1.60	1.60	0.20	0.10	MG
10/2/14 8:00 AM	1.40	1.80	1.80			MG
10/2/14 9:00 AM	1.40	1.80	1.80			MG
10/2/14 10:00 AM	1.20	1.40	1.40			MG
10/2/14 11:00 AM	1.20	1.40	1.40			MG
10/2/14 12:00 PM	1.20	1.40	1.40	0.20	0.20	MG
10/2/14 1:00 PM	1.20	1.40	1.40			MG
10/2/14 2:00 PM	1.20	1.40	1.20			MG
10/2/14 3:00 PM	1.13	1.04	1.31			LG
10/2/14 4:00 PM	1.22	0.97	1.22			LG
10/2/14 5:00 PM	0.56	0.78	0.72	0.06	0.13	LG
10/2/14 6:00 PM	0.51	1.00	1.18			LG
10/2/14 7:00 PM	1.05	1.29	1.17			LG
10/2/14 8:00 PM	1.07	1.33	1.22			LG
10/2/14 9:00 PM	1.00	1.07	1.15			LG
10/2/14 10:00 PM						LG
10/3/14 12:00 AM						
10/3/14 3:00 AM						
10/3/14 6:00 AM	1.00	1.25	1.76			SD
10/3/14 7:00 AM	1.00	1.20	1.40	0.00	0.10	MG
10/3/14 8:00 AM	1.00	1.40	1.40			MG
10/3/14 9:00 AM	1.20	1.40	1.40			MG
10/3/14 10:00 AM	1.20	1.40	1.40			MG
10/3/14 11:00 AM	1.20	1.20	1.20			MG
10/3/14 12:00 PM	1.00	1.00	1.00	0.00	0.20	MG
10/3/14 1:00 PM	1.20	1.20	1.20			MG
10/3/14 2:00 PM	1.00	1.20	1.20			MG
10/3/14 3:00 PM	0.80	0.80	1.00			BJR
10/3/14 4:00 PM	1.00	1.20	1.20			BJR
10/3/14 5:00 PM	1.40	1.20	1.40	0.10	0.10	BJR
10/3/14 6:00 PM	1.60	1.40	1.40			BJR
10/3/14 7:00 PM	2.60	1.20	1.00			BJR

GLENWOOD HOT SPRINGS
POOL MAINTENANCE DEPT.
 Oct-14

Time & Date	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Combined Chlorine T Pool	Combined Chlorine M-Pool	Operator Initials
10/3/14 8:00 PM	1.20	1.20	1.00			BJR
10/3/14 9:00 PM	1.20	1.00	0.80			BJR
10/3/14 10:00 PM						BJR
10/4/14 12:00 AM						
10/4/14 3:00 AM	1.25	0.95	0.66			SD
10/4/14 6:00 AM	1.05	0.89	0.77			SD
10/4/14 7:00 AM	1.00	1.20	1.20	0.00	0.20	MG
10/4/14 8:00 AM	1.00	1.40	1.40			MG
10/4/14 9:00 AM	1.00	1.40	1.40			MG
10/4/14 10:00 AM	1.20	1.60	1.60			MG
10/4/14 11:00 AM	1.20	1.60	1.60			MG
10/4/14 12:00 PM	1.20	1.40	1.40	0.00	0.10	MG
10/4/14 1:00 PM	1.20	1.40	1.40			MG
10/4/14 2:00 PM	1.00	1.40	1.40			MG
10/4/14 3:00 PM	1.00	1.00	1.20			BJR
10/4/14 4:00 PM	1.20	1.20	1.20			BJR
10/4/14 5:00 PM	1.00	1.20	1.40	0.10	0.00	BJR
10/4/14 6:00 PM	1.00	1.80	1.60			BJR
10/4/14 7:00 PM	1.00	1.60	1.20			BJR
10/4/14 8:00 PM	1.20	1.60	1.20			BJR
10/4/14 9:00 PM	1.00	1.40	1.20			BJR
10/4/14 10:00 PM						BJR
10/5/14 12:00 AM						
10/5/14 3:00 AM	1.85	1.36	1.45			SD
10/5/14 6:00 AM	1.30	1.91	1.45			SD
10/5/14 7:00 AM	1.00	1.00	1.40	0.20	0.20	MW
10/5/14 8:00 AM	1.00	1.20	1.20			MW
10/5/14 9:00 AM	0.80	1.00	1.20			MW
10/5/14 10:00 AM	0.80	1.20	1.20			MW
10/5/14 11:00 AM	1.00	1.20	1.40			MW
10/5/14 12:00 PM	1.20	1.20	1.20	0.20	0.20	MW
10/5/14 1:00 PM	1.20	1.00	1.20			MW
10/5/14 2:00 PM	1.00	1.00	1.00			MW
10/5/14 3:00 PM	0.79	0.84	1.00			LG
10/5/14 4:00 PM	0.88	0.77	1.01			LG
10/5/14 5:00 PM	0.74	1.47	1.24	0.25	0.35	LG
10/5/14 6:00 PM	1.11	1.67	1.63			LG
10/5/14 7:00 PM	0.39	1.19	1.07			LG
10/5/14 8:00 PM	1.21	1.20	0.97			LG
10/5/14 9:00 PM	0.72	1.12	0.79			LG
10/5/14 10:00 PM						LG
10/6/14 12:00 AM						
10/6/14 3:00 AM	1.98	1.11	0.98			SD
10/6/14 6:00 AM	1.58	1.16	0.88			SD
10/6/14 7:00 AM	1.80	1.00	1.00	0.20	0.0.	MW
10/6/14 8:00 AM	1.60	1.20	1.20			MW
10/6/14 9:00 AM	1.00	1.20	1.00			MW
10/6/14 10:00 AM	0.60	1.00	1.20			MW
10/6/14 11:00 AM	0.80	1.00	1.20			MW
10/6/14 12:00 PM	1.20	1.00	1.00	0.20	0.20	MW
10/6/14 1:00 PM	1.60	1.00	1.20			MW
10/6/14 2:00 PM	1.20	0.80	1.00			MW
10/6/14 3:00 PM	1.20	1.48	1.44			LG
10/6/14 4:00 PM	1.37	1.39	1.40			LG

GLENWOOD HOT SPRINGS
POOL MAINTENANCE DEPT.
 Oct-14

Time & Date	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Combined Chlorine T Pool	Combined Chlorine M-Pool	Operator Initials
10/6/14 5:00 PM	1.50	1.81	1.38	0.31	0.06	LG
10/6/14 6:00 PM	1.36	1.40	1.17			LG
10/6/14 7:00 PM	0.90	1.16	1.13			LG
10/6/14 8:00 PM	1.01	1.19	1.22			LG
10/6/14 9:00 PM	0.90	1.28	1.16			LG
10/6/14 10:00 PM						LG
10/7/14 12:00 AM						
10/7/14 3:00 AM	1.25	1.64	1.43			SD
10/7/14 6:00 AM	1.93	1.74	1.25			SD
10/7/14 7:00 AM	1.20	1.60	1.60	0.10	0.20	MG
10/7/14 8:00 AM	1.20	1.40	1.60			MG
10/7/14 9:00 AM	1.20	1.60	1.60			MG
10/7/14 10:00 AM	1.20	1.40	1.60			MW
10/7/14 11:00 AM	1.40	1.60	1.40			MW
10/7/14 12:00 PM	1.60	1.20	1.40	0.20	0.20	MW
10/7/14 1:00 PM	1.40	1.40	1.40			MW
10/7/14 2:00 PM	1.20	1.40	1.60			MW
10/7/14 3:00 PM	0.95	1.39	1.36			LG
10/7/14 4:00 PM	1.75	1.26	1.33			LG
10/7/14 5:00 PM	2.09	1.68	1.45	0.10	0.29	LG
10/7/14 6:00 PM	0.81	1.60	1.49			LG
10/7/14 7:00 PM	0.80	1.68	1.66			LG
10/7/14 8:00 PM	1.35	1.62	1.55			LG
10/7/14 9:00 PM	1.27	1.49	1.17			LG
10/7/14 10:00 PM						LG
10/8/14 12:00 AM						BJR
10/8/14 3:00 AM	1.00	0.80	0.60			BJR
10/8/14 6:00 AM	1.00	1.00	0.80			BJR
10/8/14 7:00 AM	1.00	1.20	1.20	0.20	0.20	MG
10/8/14 8:00 AM	1.00	1.40	1.40			MG
10/8/14 9:00 AM	1.00	1.40	1.40			MG
10/8/14 10:00 AM	1.00	1.60	1.60			MG
10/8/14 11:00 AM	1.20	1.60	1.60			MG
10/8/14 12:00 PM	1.00	1.20	1.20	0.10	0.20	MG
10/8/14 1:00 PM	1.00	1.00	1.00			MG
10/8/14 2:00 PM	1.00	1.00	1.00			MG
10/8/14 3:00 PM	0.67	1.22	1.03			LG
10/8/14 4:00 PM	1.56	1.32	1.62			LG
10/8/14 5:00 PM	1.23	1.70	1.71	0.38	0.06	LG
10/8/14 6:00 PM	0.85	1.79	1.78			LG
10/8/14 7:00 PM	0.65	1.20	1.40			LG
10/8/14 8:00 PM						LG
10/8/14 9:00 PM	1.90	1.32	1.28			LG
10/8/14 10:00 PM						LG
10/9/14 12:00 AM						BJR
10/9/14 3:00 AM	1.20	1.00	0.80			BJR
10/9/14 6:00 AM	1.20	1.20	1.00			BJR
10/9/14 7:00 AM	1.40	1.40	1.40	0.20	2.00	MG
10/9/14 8:00 AM	1.40	1.60	1.60			MG
10/9/14 9:00 AM	1.20	1.60	1.60			MG
10/9/14 10:00 AM	1.20	1.60	1.60			MG
10/9/14 11:00 AM	1.00	1.40	1.40			MG
10/9/14 12:00 PM	1.00	1.40	1.40	0.20	0.20	MG
10/9/14 1:00 PM	1.00	1.40	1.40			MG

GLENWOOD HOT SPRINGS
POOL MAINTENANCE DEPT.
 Oct-14

Time & Date	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Combined Chlorine T Pool	Combined Chlorine M-Pool	Operator Initials
10/9/14 2:00 PM	1.20	1.40	1.40			MG
10/9/14 3:00 PM	1.76	1.53	1.15			LG
10/9/14 4:00 PM	0.87	1.27	1.70			LG
10/9/14 5:00 PM	1.69	0.81	1.71	0.37	0.17	LG
10/9/14 6:00 PM	1.33	1.80	1.79			LG
10/9/14 7:00 PM	1.72	1.04	1.69			LG
10/9/14 8:00 PM	1.24	1.53	1.51			LG
10/9/14 9:00 PM	1.23	1.17	1.15			LG
10/9/14 10:00 PM						LG
10/10/14 12:00 AM						
10/10/14 3:00 AM						
10/10/14 6:00 AM	0.98	1.02	0.98			SD
10/10/14 7:00 AM	1.00	1.20	1.00	0.00	0.20	MG
10/10/14 8:00 AM	1.40	1.40	1.40			MG
10/10/14 9:00 AM	1.40	1.60	1.60			MG
10/10/14 10:00 AM	1.20	1.40	1.40			MG
10/10/14 11:00 AM	1.20	1.40	1.40			MG
10/10/14 12:00 PM	1.20	1.00	1.00	0.00	0.20	MG
10/10/14 1:00 PM	1.20	1.00	1.00			MG
10/10/14 2:00 PM	1.00	1.00	1.00			MG
10/10/14 3:00 PM	1.00	1.20	1.00			BJR
10/10/14 4:00 PM	1.20	1.00	1.20			BJR
10/10/14 5:00 PM	1.00	1.20	1.00	0.10	0.10	BJR
10/10/14 6:00 PM	1.00	1.00	1.00			BJR
10/10/14 7:00 PM	1.20	1.40	1.20			BJR
10/10/14 8:00 PM	1.20	1.00	1.20			BJR
10/10/14 9:00 PM	1.20	1.00	0.80			BJR
10/10/14 10:00 PM						BJR
10/11/14 12:00 AM						
10/11/14 3:00 AM	0.98	0.76	0.68			SD
10/11/14 6:00 AM	1.45	1.77	1.27			SD
10/11/14 7:00 AM	1.20	1.40	1.40	0.10	0.20	MG
10/11/14 8:00 AM	1.40	1.40	1.40			MG
10/11/14 9:00 AM	1.40	1.60	1.60			MG
10/11/14 10:00 AM	1.40	1.60	1.60			MG
10/11/14 11:00 AM	1.20	1.40	1.40			MG
10/11/14 12:00 PM	1.00	1.20	1.20	0.10	0.20	MG
10/11/14 1:00 PM	1.00	1.00	1.00			MG
10/11/14 2:00 PM	1.00	1.00	1.00			MG
10/11/14 3:00 PM	1.00	1.00	1.20			BJR
10/11/14 4:00 PM	1.20	1.00	1.20			BJR
10/11/14 5:00 PM	1.00	1.00	1.00	0.10	0.00	BJR
10/11/14 6:00 PM	1.20	1.20	1.20			BJR
10/11/14 7:00 PM	1.80	1.80	1.40			BJR
10/11/14 8:00 PM	1.20	1.80	1.40			BJR
10/11/14 9:00 PM	1.20	1.60	1.20			BJR
10/11/14 10:00 PM						BJR
10/12/14 12:00 AM						
10/12/14 3:00 AM	1.47	1.50	0.96			SD
10/12/14 6:00 AM		1.41	1.12			SD
10/12/14 7:00 AM						
10/12/14 8:00 AM	1.40	1.40	1.60			MW
10/12/14 9:00 AM	1.60	1.60	1.80			MW
10/12/14 10:00 AM	1.40	1.40	1.60			MW

GLENWOOD HOT SPRINGS
POOL MAINTENANCE DEPT.
 Oct-14

Time & Date	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Combined Chlorine T Pool	Combined Chlorine M-Pool	Operator Initials
10/12/14 11:00 AM	1.20	1.20	1.40			MW
10/12/14 12:00 PM	1.00	1.20	1.40		0.20	MW
10/12/14 1:00 PM	1.20	1.20	1.20			MW
10/12/14 2:00 PM	1.20	1.20	1.20			MW
10/12/14 3:00 PM	1.04	0.76	0.59			LG
10/12/14 4:00 PM	1.14	0.80	0.79			LG
10/12/14 5:00 PM	0.83	1.24	0.85	0.27	0.16	LG
10/12/14 6:00 PM	1.06	1.00	0.99			LG
10/12/14 7:00 PM	0.77	1.28	1.14			LG
10/12/14 8:00 PM	0.83	1.25	1.27			LG
10/12/14 9:00 PM	0.94	1.07	1.14			LG
10/12/14 10:00 PM						LG
10/13/14 12:00 AM						
10/13/14 3:00 AM	1.49	1.04	0.95			SD
10/13/14 6:00 AM	1.43	1.72	1.68			SD
10/13/14 7:00 AM	1.40	1.60	1.60	0.0.	0.0.	MW
10/13/14 8:00 AM	1.20	1.40	1.20			MW
10/13/14 9:00 AM	1.00	1.20	1.20			MW
10/13/14 10:00 AM	0.80	1.00	1.20			MW
10/13/14 11:00 AM	1.00	1.00	1.20			MW
10/13/14 12:00 PM	1.20	1.00	1.20	0.20	0.20	MW
10/13/14 1:00 PM	1.00	1.00	1.20			MW
10/13/14 2:00 PM	1.00	1.00	1.00			MW
10/13/14 3:00 PM	0.99	0.60	0.58			LG
10/13/14 4:00 PM	1.82	0.95	0.98			LG
10/13/14 5:00 PM	1.58	1.52	1.02	0.19	0.30	LG
10/13/14 6:00 PM	1.73	1.24	0.96			LG
10/13/14 7:00 PM	0.78	1.19	1.25			LG
10/13/14 8:00 PM	0.60	1.30	1.14			LG
10/13/14 9:00 PM	0.50	1.25	1.21			LG
10/13/14 10:00 PM						LG
10/14/14 12:00 AM						
10/14/14 3:00 AM	0.88	1.50	1.70			SD
10/14/14 6:00 AM	2.20	0.98	0.92			SD
10/14/14 7:00 AM	1.60	0.80	1.20	0.20	0.20	MW
10/14/14 8:00 AM	1.40	0.80	1.00			MW
10/14/14 9:00 AM	1.40	0.60	0.60			MW
10/14/14 10:00 AM	1.00	0.80	1.00			MW
10/14/14 11:00 AM	1.00	1.20	1.20			MW
10/14/14 12:00 PM	0.80	1.00	1.20	0.20	0.20	MW
10/14/14 1:00 PM	1.20	0.80	1.00			MW
10/14/14 2:00 PM	1.56	1.02	0.60			LG
10/14/14 3:00 PM	0.86	0.79	0.90			LG
10/14/14 4:00 PM	0.86	0.79	0.90			LG
10/14/14 5:00 PM	0.87	1.03	1.23	0.15	0.05	LG
10/14/14 6:00 PM	1.52	1.44	1.46			LG
10/14/14 7:00 PM	1.05	1.48	0.97			LG
10/14/14 8:00 PM	1.20	1.01	1.00			LG
10/14/14 9:00 PM	1.23	0.68	0.73			LG
10/14/14 10:00 PM						LG
10/15/14 12:00 AM						BJR
10/15/14 3:00 AM	0.40	0.60	0.60			BJR
10/15/14 6:00 AM	1.00	1.00	0.80			BJR
10/15/14 7:00 AM	1.00	1.60	1.40	0.20	0.20	MG

GLENWOOD HOT SPRINGS
POOL MAINTENANCE DEPT.
 Oct-14

Time & Date	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Combined Chlorine T Pool	Combined Chlorine M-Pool	Operator Initials
10/15/14 8:00 AM	1.00	1.60	1.60			MG
10/15/14 9:00 AM	1.00	1.60	1.60			MG
10/15/14 10:00 AM	1.00	1.40	1.40			MG
10/15/14 11:00 AM	1.00	1.40	1.40			MG
10/15/14 12:00 PM	1.00	1.40	1.20	0.20	0.20	MG
10/15/14 1:00 PM	1.00	1.20	1.20			MG
10/15/14 2:00 PM	1.00	1.20	1.20			MG
10/15/14 3:00 PM	1.41	0.99	0.94			LG
10/15/14 4:00 PM	0.31	1.02	1.15			LG
10/15/14 5:00 PM	1.01	1.26	1.30	0.09	0.09	LG
10/15/14 6:00 PM	0.57	1.13	1.37			LG
10/15/14 7:00 PM	0.82	1.23	1.35			LG
10/15/14 8:00 PM	0.95	1.40	1.46			LG
10/15/14 9:00 PM	2.16	1.42	1.34			LG
10/15/14 10:00 PM						LG
10/16/14 12:00 AM	1.20	1.00	0.80			BJR
10/16/14 3:00 AM	1.40	1.40	1.00			BJR
10/16/14 6:00 AM	1.20	1.40	1.00			BJR
10/16/14 7:00 AM	1.00	1.40	1.20	0.20	0.20	MW
10/16/14 8:00 AM	1.00	1.20	1.20			MW
10/16/14 9:00 AM	1.00	1.00	1.00			MW
10/16/14 10:00 AM	0.80	0.80	0.80			MW
10/16/14 11:00 AM	0.80	1.00	1.00			MW
10/16/14 12:00 PM	1.00	1.00	1.20	0.20	0.20	MW
10/16/14 1:00 PM	1.20	1.00	1.20			MW
10/16/14 2:00 PM	1.00	1.00	1.20			MW
10/16/14 3:00 PM	1.00	1.00	1.00			MG
10/16/14 4:00 PM	1.00	1.00	1.00			MG
10/16/14 5:00 PM	1.00	1.20	1.20	0.20	0.20	MG
10/16/14 6:00 PM	1.20	1.20	1.20			MG
10/16/14 7:00 PM	1.20	1.40	1.40			MG
10/16/14 8:00 PM	1.40	1.40	1.40			MG
10/16/14 9:00 PM	1.20	1.40	1.40			MG
10/16/14 10:00 PM	1.00	1.20	1.20			MG
10/17/14 12:00 AM						
10/17/14 3:00 AM		0.77	0.55			SD
10/17/14 6:00 AM	2.20	0.68	0.63			SD
10/17/14 7:00 AM	1.80	1.40	1.40	0.00	0.20	MG
10/17/14 8:00 AM	1.60	2.00	1.80			MG
10/17/14 9:00 AM	1.60	2.00	2.00			MG
10/17/14 10:00 AM	1.40	2.00	2.00			MG
10/17/14 11:00 AM	1.20	1.60	1.60			MG
10/17/14 12:00 PM	1.00	1.20	1.20	0.10	0.20	MG
10/17/14 1:00 PM	1.00	1.00	1.00			MG
10/17/14 2:00 PM	0.60	1.20	1.20			MG
10/17/14 3:00 PM	1.00	0.80	1.00			BJR
10/17/14 4:00 PM	1.00	1.00	1.20			BJR
10/17/14 5:00 PM	1.00	1.40	1.40	0.10	0.10	BJR
10/17/14 6:00 PM	1.60	1.20	1.20			BJR
10/17/14 7:00 PM	1.20	1.60	1.20			BJR
10/17/14 8:00 PM	1.40	1.20	1.00			BJR
10/17/14 9:00 PM	1.00	0.80	0.80			BJR
10/17/14 10:00 PM						BJR
10/18/14 12:00 AM						

GLENWOOD HOT SPRINGS
POOL MAINTENANCE DEPT.
 Oct-14

Time & Date	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Combined Chlorine T Pool	Combined Chlorine M-Pool	Operator Initials
10/18/14 3:00 AM	1.45	1.21	1.24			SD
10/18/14 6:00 AM	1.78	1.65	1.58			SD
10/18/14 7:00 AM	1.00	1.60	1.60	0.10	0.20	MG
10/18/14 8:00 AM	1.20	1.80	1.60			MG
10/18/14 9:00 AM	1.20	1.80	2.00			MG
10/18/14 10:00 AM	1.20	1.80	1.80			MG
10/18/14 11:00 AM	1.00	1.60	1.60			MG
10/18/14 12:00 PM	1.00	1.20	1.20	0.20	0.20	MG
10/18/14 1:00 PM	1.00	1.00	1.00			MG
10/18/14 2:00 PM	1.00	1.00	1.00			MG
10/18/14 3:00 PM	1.40	0.80	1.00			BJR
10/18/14 4:00 PM	1.00	1.40	1.00			BJR
10/18/14 5:00 PM	1.00	2.00	1.20	0.10	0.20	BJR
10/18/14 6:00 PM	1.00	1.80	1.60			BJR
10/18/14 7:00 PM	1.00	1.40	1.60			BJR
10/18/14 8:00 PM	1.80	1.20	1.20			BJR
10/18/14 9:00 PM	1.00	1.40	1.20			BJR
10/18/14 10:00 PM						BJR
10/19/14 12:00 AM						
10/19/14 3:00 AM	1.32	1.77	1.89			SD
10/19/14 6:00 AM	1.67	1.05	0.96			SD
10/19/14 7:00 AM	2.20	0.80	1.00	0.20	0.20	MW
10/19/14 8:00 AM	2.20	1.00	1.20			MW
10/19/14 9:00 AM	2.00	1.00	1.00			MW
10/19/14 10:00 AM	1.80	1.20	1.20			MW
10/19/14 11:00 AM	1.40	1.00	1.20			MW
10/19/14 12:00 PM	1.00	0.80	1.00	0.20	0.20	MW
10/19/14 1:00 PM	1.00	1.00	1.20			MW
10/19/14 2:00 PM	1.00	1.20	1.20			MW
10/19/14 3:00 PM	1.10	0.66	0.56			LG
10/19/14 4:00 PM	0.78	1.27	0.71			LG
10/19/14 5:00 PM	1.73	1.35	1.00	0.21	0.05	LG
10/19/14 6:00 PM	1.33	1.38	1.56			LG
10/19/14 7:00 PM	2.19	1.76	1.87			LG
10/19/14 8:00 PM	1.22	1.75	1.80			LG
10/19/14 9:00 PM	1.73	1.58	1.38			LG
10/19/14 10:00 PM						LG
10/20/14 12:00 AM						
10/20/14 3:00 AM	2.20	1.68	1.62			SD
10/20/14 6:00 AM	2.09	1.62	1.58			SD
10/20/14 7:00 AM	2.00	1.80	1.60	0.20	0.0.	MW
10/20/14 8:00 AM	2.00	1.60	1.80			MW
10/20/14 9:00 AM	2.00	2.00	1.80			MW
10/20/14 10:00 AM	1.80	1.40	1.60			MW
10/20/14 11:00 AM	1.40	1.40	1.60			MW
10/20/14 12:00 PM	1.00	1.40	1.40	0.20	0.20	MW
10/20/14 1:00 PM	0.80	1.40	1.20			MW
10/20/14 2:00 PM	1.20	1.20	1.40			MW
10/20/14 3:00 PM	0.74	0.99	0.79			LG
10/20/14 4:00 PM	0.76	0.90	0.92			LG
10/20/14 5:00 PM	0.89	0.98	0.95	0.20	0.25	LG
10/20/14 6:00 PM	0.76	0.97	1.75			LG
10/20/14 7:00 PM	0.82	1.32	1.54			LG
10/20/14 8:00 PM	2.10	1.43	1.67			LG

GLENWOOD HOT SPRINGS
POOL MAINTENANCE DEPT.
 Oct-14

Time & Date	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Combined Chlorine T Pool	Combined Chlorine M-Pool	Operator Initials
10/20/14 9:00 PM	2.05	1.28	1.21			LG
10/20/14 10:00 PM						LG
10/21/14 12:00 AM						
10/21/14 3:00 AM	2.20	1.91	1.85			SD
10/21/14 6:00 AM	1.71	1.59	1.51			SD
10/21/14 7:00 AM	1.60	1.60	1.40	0.20	0.20	MW
10/21/14 8:00 AM	1.60	1.40	1.40			MW
10/21/14 9:00 AM	1.40	1.40	1.60			MW
10/21/14 10:00 AM	1.20	1.20	1.20			MW
10/21/14 11:00 AM	1.20	1.40	1.60			MW
10/21/14 12:00 PM	1.20	1.80	2.00	0.20	0.20	MW
10/21/14 1:00 PM	1.20	1.60	1.80			MW
10/21/14 2:00 PM	1.20	1.60	1.60			MW
10/21/14 3:00 PM	1.20	1.60	1.60			MG
10/21/14 4:00 PM	1.52	1.44	1.59			LG
10/21/14 5:00 PM	1.53	1.47	1.68	0.30	0.33	LG
10/21/14 6:00 PM	2.20	1.36	1.81			LG
10/21/14 7:00 PM	0.51	0.59	1.54			LG
10/21/14 8:00 PM	1.02	1.09	1.08			LG
10/21/14 9:00 PM	0.71	0.73	0.58			LG
10/21/14 10:00 PM						LG
10/22/14 12:00 AM						BJR
10/22/14 3:00 AM	1.00	0.80	1.00			BJR
10/22/14 6:00 AM	1.20	1.00	1.00			BJR
10/22/14 7:00 AM	1.20	1.00	1.00	0.10	0.20	MG
10/22/14 8:00 AM	1.00	1.20	1.20			MG
10/22/14 9:00 AM	1.00	1.20	1.20			MG
10/22/14 10:00 AM	1.00	1.40	1.40			MG
10/22/14 11:00 AM	0.80	1.40	1.40			MG
10/22/14 12:00 PM	1.00	1.40	1.40	0.20	0.20	MG
10/22/14 1:00 PM	1.00	1.20	1.20			MG
10/22/14 2:00 PM	1.00	1.20	1.20			MG
10/22/14 3:00 PM	1.61	1.45	0.79			LG
10/22/14 4:00 PM	1.35	1.49	1.25			LG
10/22/14 5:00 PM	1.37	1.99	2.13	0.11	0.10	LG
10/22/14 6:00 PM	2.30	1.91	2.10			LG
10/22/14 7:00 PM	1.39	1.70	1.73			LG
10/22/14 8:00 PM	1.74	1.54	1.56			LG
10/22/14 9:00 PM	1.71	1.36	1.09			LG
10/22/14 10:00 PM						LG
10/23/14 12:00 AM						BJR
10/23/14 3:00 AM	1.20	1.20	0.80			BJR
10/23/14 6:00 AM	1.20	1.60	1.00			BJR
10/23/14 7:00 AM	1.60	1.40	1.40	0.20	0.20	MW
10/23/14 8:00 AM	1.80	1.20	1.40			MW
10/23/14 9:00 AM	1.60	1.20	1.20			MW
10/23/14 10:00 AM	1.40	1.20	1.00			MW
10/23/14 11:00 AM	1.00	1.20	1.00			MW
10/23/14 12:00 PM	0.80	1.20	1.20	0.20	0.20	MW
10/23/14 1:00 PM	1.00	1.40	1.20			MW
10/23/14 2:00 PM	1.00	1.60	1.40			MW
10/23/14 3:00 PM	1.00	1.40	1.20			MG
10/23/14 4:00 PM	1.00	1.20	1.20			MG
10/23/14 5:00 PM	1.00	1.00	1.00	0.20	0.20	MG

GLENWOOD HOT SPRINGS
POOL MAINTENANCE DEPT.
 Oct-14

Time & Date	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Combined Chlorine T Pool	Combined Chlorine M-Pool	Operator Initials
10/23/14 6:00 PM	1.20	1.20	1.20			MG
10/23/14 7:00 PM	1.20	1.20	1.20			MG
10/23/14 8:00 PM	1.20	1.40	1.40			MG
10/23/14 9:00 PM	1.00	1.40	1.40			MG
10/23/14 10:00 PM	1.00	1.40	1.40			MG
10/24/14 12:00 AM						
10/24/14 3:00 AM						
10/24/14 6:00 AM	1.82	1.58	1.48			SD
10/24/14 7:00 AM	1.60	1.60	1.60	0.00	0.20	MG
10/24/14 8:00 AM	1.60	2.00	1.80			MG
10/24/14 9:00 AM	1.60	2.00	2.00			MG
10/24/14 10:00 AM	1.60	2.00	2.00			MG
10/24/14 11:00 AM	1.60	1.80	1.80			MG
10/24/14 12:00 PM	1.40	1.80	1.80	0.10	0.20	MG
10/24/14 1:00 PM	1.20	1.20	1.20			MG
10/24/14 2:00 PM	1.20	1.20	1.20			MG
10/24/14 3:00 PM	1.00	0.80	1.00			BJR
10/24/14 4:00 PM	1.00	1.20	1.20			BJR
10/24/14 5:00 PM	1.20	1.00	1.20	0.10	0.00	BJR
10/24/14 6:00 PM	1.40	1.40	1.40			BJR
10/24/14 7:00 PM	1.20	1.40	1.20			BJR
10/24/14 8:00 PM	2.00	1.20	1.00			BJR
10/24/14 9:00 PM	1.40	0.80	0.80			BJR
10/24/14 10:00 PM						BJR
10/25/14 12:00 AM						
10/25/14 3:00 AM	1.25	0.64	0.60			SD
10/25/14 6:00 AM	1.48	1.81	1.65			SD
10/25/14 7:00 AM	1.40	1.80	1.80	0.10	0.20	MG
10/25/14 8:00 AM	1.20	1.80	1.80			MG
10/25/14 9:00 AM	1.20	2.00	1.80			MG
10/25/14 10:00 AM	1.00	2.00	1.80			MG
10/25/14 11:00 AM	1.00	1.60	1.60			MG
10/25/14 12:00 PM	1.00	1.60	1.40	0.10	0.20	MG
10/25/14 1:00 PM	1.00	1.20	1.20			MG
10/25/14 2:00 PM	1.00	1.00	1.20			MG
10/25/14 3:00 PM	1.00	1.00	1.00			BJR
10/25/14 4:00 PM	0.80	1.00	1.20			BJR
10/25/14 5:00 PM	1.00	1.00	1.40	0.10	0.00	BJR
10/25/14 6:00 PM	1.20	1.20	1.40			BJR
10/25/14 7:00 PM	0.80	1.40	1.40			BJR
10/25/14 8:00 PM	0.60	1.20	1.40			BJR
10/25/14 9:00 PM	1.60	1.20	1.40			BJR
10/25/14 10:00 PM						BJR
10/26/14 12:00 AM						
10/26/14 3:00 AM	1.74	1.16	0.98			SD
10/26/14 6:00 AM	1.28	1.94	1.89			SD
10/26/14 7:00 AM	1.60	1.80	1.80		0.20	MW
10/26/14 8:00 AM	1.60	1.80	1.60			MW
10/26/14 9:00 AM	1.40	1.80	1.60			MW
10/26/14 10:00 AM	1.40	2.20	1.60			MW
10/26/14 11:00 AM	1.20	2.00	1.80			MW
10/26/14 12:00 PM	0.80	1.60	1.40	0.20	0.20	MW
10/26/14 1:00 PM	1.00	1.20	1.40			MW
10/26/14 2:00 PM	1.00	1.20	1.20			MW

GLENWOOD HOT SPRINGS
POOL MAINTENANCE DEPT.
 Oct-14

Time & Date	Free Chlorine T - Pool	Free Chlorine North	Free Chlorine South	Combined Chlorine T Pool	Combined Chlorine M-Pool	Operator Initials
10/26/14 3:00 PM	1.00	1.00	1.20			BJR
10/26/14 4:00 PM	1.20	1.00	1.00			BJR
10/26/14 5:00 PM	1.00	1.40	1.00	0.10	0.10	BJR
10/26/14 6:00 PM	1.60	2.00	1.60			BJR
10/26/14 7:00 PM	1.80	1.60	1.20			BJR
10/26/14 8:00 PM	2.20	1.60	1.40			BJR
10/26/14 9:00 PM	1.80	1.40	1.20			BJR
10/26/14 10:00 PM						BJR
10/27/14 12:00 AM						
10/27/14 3:00 AM	1.72	1.31	1.28			SD
10/27/14 6:00 AM	1.89	1.69	1.66			SD
10/27/14 7:00 AM	2.00	2.00	1.80	0.20	0.20	MW
10/27/14 8:00 AM	2.20	1.60	1.80			MW
10/27/14 9:00 AM	2.00	1.80	1.80			MW
10/27/14 10:00 AM	1.80	1.60	1.80			MW
10/27/14 11:00 AM	1.40	1.40	1.60			MW
10/27/14 12:00 PM	1.00	1.40	1.60	0.20	0.20	MW
10/27/14 1:00 PM	0.60		1.60			MW
10/27/14 2:00 PM	0.80					BJR
10/27/14 3:00 PM	1.00	1.00	1.00			BJR
10/27/14 4:00 PM	1.00	1.00	1.00			BJR
10/27/14 5:00 PM	1.20	1.20	1.20	0.10	0.00	BJR
10/27/14 6:00 PM	1.40	1.40	1.40			BJR
10/27/14 7:00 PM	2.20	2.20	1.40			BJR
10/27/14 8:00 PM	1.40	1.40	1.40			BJR
10/27/14 9:00 PM	1.20	1.20	1.00			BJR
10/27/14 10:00 PM						BJR
10/28/14 12:00 AM						
10/28/14 3:00 AM	1.67	1.62	1.58			SD
10/28/14 6:00 AM	2.20	1.25	1.04			SD
10/28/14 7:00 AM	1.20	1.00	0.80	0.20	0.20	MW
10/28/14 8:00 AM	1.20	1.00	0.80			MW
10/28/14 9:00 AM	1.20	1.20	1.00			MW
10/28/14 10:00 AM	1.00	1.20	1.00			MW
10/28/14 11:00 AM	1.00	1.20	1.20			MW
10/28/14 12:00 PM	0.80	1.20	1.00	0.20	0.20	MW
10/28/14 1:00 PM	1.00	1.00	0.80			MW
10/28/14 2:00 PM	1.00	0.80	0.80			MW
10/28/14 3:00 PM	1.00	0.80	0.80			MG
10/28/14 4:00 PM	1.00	1.00	0.80			MG
10/28/14 5:00 PM	1.00	1.00	1.00	0.20	0.20	MG
10/28/14 6:00 PM	1.00	1.00	1.00			MG
10/28/14 7:00 PM	1.00	1.20	1.20			MG
10/28/14 8:00 PM	1.00	1.20	1.20			MG
10/28/14 9:00 PM	1.00	1.40	1.40			MG
10/28/14 10:00 PM	1.00	1.40	1.40			MG